

# Model 266HSH Gauge Model 266NSH Absolute

Engineered solutions for all applications

Measurement made easy



## Base accuracy

- from 0.06 % of calibrated span (optional 0.04 %)

## Reliable sensing system coupled with very latest digital technologies

- provides large turn down ratio up to 100:1

## Comprehensive sensor choice

- optimize in-use total performance and stability

## 10-year stability

- 0.15 % of URL

## Flexible configuration facilities

- provided locally via local LCD keypad

## New TTG (Through-The-Glass) keypad technology

- allows quick and easy local configuration without opening the cover, even in explosion proof environments

## IEC 61508 certification

- version for SIL2 (1oo1) and SIL3 (1oo2) applications

## PED compliance

- Category III for PS > 20 MPa, 200 bar
- Sound Engineering Practice (SEP) for PS ≤ 20 MPa, 200 bar

## WirelessHART version

- the battery powered solution compliant to IEC 62591

## Best-in-class battery life

- up to 10 years @ 32 s update time
- in-field replaceable

# Model 266HSH Gauge

# Model 266NSH Absolute

## Functional Specifications

### Range and span limits

Sensor Code	Upper Range	Lower Range Limit (LRL)	Minimum span	
	Limit (URL)	266HSH (Δ)	266HSH	266NSH
E	16 kPa	−16 kPa	0.54 kPa	
	160 mbar	−160 mbar	5.4 mbar	
	64 inH2O	−64 inH2O	2.16 inH2O	
F	40 kPa	−40 kPa	0.4 kPa	0.67 kPa
	400 mbar	−400 mbar	4 mbar	6.7 mbar
	160 inH2O	−160 inH2O	1.6 inH2O	5 mmHg
H	160 kPa	0.07 kPa abs (§)	1.6 kPa	2.67 kPa
	1600 mbar	0.7 mbar abs (§)	16 mbar	26.7 mbar
	642 inH2O	0.5 mmHg (§)	6.4 inH2O	20 mmHg
M	600 kPa	0.07 kPa abs (§)	6 kPa	10 kPa
	6 bar	0.7 mbar abs (§)	0.06 bar	0.1 bar
	87 psi	0.5 mmHg (§)	0.87 psi	1.45 psi
P	2400 kPa	0.07 kPa abs (§)	24 kPa	40 kPa
	24 bar	0.7 mbar abs (§)	0.24 bar	0.4 bar
	348 psi	0.5 mmHg (§)	3.5 psi	5.8 psi
Q	8000 kPa	0.07 kPa abs (§)	80 kPa	134 kPa
	80 bar	0.7 mbar abs (§)	0.8 bar	1.34 bar
	1160 psi	0.5 mmHg (§)	11.6 psi	19.4 psi
S	16000 kPa	0.07 kPa abs (§)	160 kPa	267 kPa
	160 bar	0.7 mbar abs (§)	1.6 bar	2.67 bar
	2320 psi	0.5 mmHg (§)	23.2 psi	38.7 psi
W	70000 kPa	0.07 kPa abs (§)	1400 kPa	
	700 bar	0.7 mbar abs (§)	14 bar	
	10150 psi	0.5 mmHg (§)	203 psi	
Z	105000 kPa	0.07 kPa abs (§)	10500 kPa	
	1050 bar	0.7 mbar abs (§)	105 bar	
	15225 psi	0.5 mmHg (§)	1522 psi	

(Δ) Lower Range Limit (LRL) for 266NSH is 0.07kPa abs, 0.7mbar abs, 0.5mmHg for all ranges.

(§) Lower Range Limit is 0.135 kPa abs, 1.35 mbar abs, 1 mmHg for inert Galden or 0.4 kPa abs, 4 mbar abs, 3 mmHg for inert Halocarbon.

### Span limits

Maximum span = URL

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

### Zero suppression and elevation

Zero and span can be adjusted to any value within the range limits detailed in the table as long as:

— calibrated span ≥ minimum span

### Damping (feature not available for WirelessHART version)

Selectable time constant : between 0 and 60 s

This is in addition to sensor response time.

### Turn on time

Operation within specification in less than 10 s with minimum damping.

### Insulation resistance

> 100 MΩ at 500 V DC (terminals to earth)

## Operative limits

### Pressure limits:

#### Overpressure limits

Without damage to the transmitter

Sensors	Fill fluid	Overpressure limits
Sensor E to M	Silicone oil	0.07 kPa abs, 0.7 mbar abs, 0.5 mmHg and 14 MPa, 140 bar, 2030 psi
Sensor P to S	Silicone oil	0.07 kPa abs, 0.7 mbar abs, 0.5 mmHg and 21 MPa, 210 bar, 3045 psi
Sensor W	Silicone oil	0.07 kPa abs, 0.7 mbar abs, 0.5 mmHg and 105 MPa, 1050 bar, 15225 psi
Sensor E to M	Inert (Galden)	0.135 kPa abs, 1.35 mbar abs, 1 mmHg and 14 MPa, 140 bar, 2030 psi
Sensor P to S	Inert (Galden)	0.135 kPa abs, 1.35 mbar abs, 1 mmHg and 21 MPa, 210 bar, 3045 psi
Sensor E to M	Inert (Halocarbon)	0.4 kPa abs, 4 mbar abs, 3 mmHg and 14 MPa, 140 bar, 2030 psi <sup>(1)</sup>
Sensor P to S	Inert (Halocarbon)	0.4 kPa abs, 4 mbar abs, 3 mmHg and 21 MPa, 210 bar, 3045 psi

Sensors	Connection	Overpressure limits
Sensor Z	F250C	0.07 kPa abs, 0.7 mbar abs, 0.5 mmHg and 157.5 MPa, 1575 bar, 22837 psi
Sensor Z	1/4 - 18 NPT	0.07 kPa abs, 0.7 mbar abs, 0.5 mmHg and 135 MPa, 1350 bar, 19570 psi

#### Proof pressure

The transmitter can be exposed without leaking to line pressure of up to the following values:

Sensors	Proof pressure
Sensor E, F, H, M	28 MPa, 280 bar, 4060 psi
Sensor P, Q, S	40.25 MPa, 402.5 bar, 5836 psi
Sensor W	171.50 MPa, 1715 bar, 24868 psi
Sensor Z 1/4 - 18 NPT connection	210.5 MPa, 2105 bar, 30522 psi
Sensor Z F250C connection	239,7 MPa, 2397 bar, 34763 psi

Meet ANSI/ISA-S 82.03 hydrostatic test requirements.

### Temperature limits °C ( °F) :

#### Ambient

is the operating temperature

Models 266HSH - 266NSH	Ambient temperature limits
Silicone oil for sensor E to W	-40 and 85 °C (-40 and 185 °F)
Inert (Galden) for sensor E to S	-20 and 85 °C (-4 and 185 °F)
Inert (Halocarbon) for sensor E to S	-20 and 85 °C (-4 and 185 °F)
Sensor Z without filling	-40 and 85 °C (-40 and 185 °F)

Models 266HSH - 266NSH	Ambient temperature limits
LCD integral display	-40 and 85 °C (-40 and 185 °F)
LCD display may not be clearly readable below -20 °C (-4 °F) or above +70 °C (+158 °F)	

Models 266HSH - 266NSH	Ambient temperature limit
Painted AISI 316 L ss housing	max 70 °C (158 °F) continuous

#### IMPORTANT

For Hazardous Atmosphere applications see the temperature range specified on the certificate/approval relevant to the aimed type of protection.

#### Process

Models 266HSH - 266NSH	Process temperature limits
Silicone oil for sensor E to W	-40 and 121 °C (-40 and 250 °F) <sup>(1)</sup>
Inert (Galden) for sensor E to S	-20 and 100 °C (-4 and 212 °F) <sup>(2)</sup>
Inert (Halocarbon) for sensor E to S	-20 and 100 °C (-4 and 212 °F) <sup>(2)</sup>
Sensor Z without filling	-40 and 121 °C (-40 and 250 °F)

(1) 100 °C (212 °F) for application below atmospheric pressure

(2) 65 °C (150 °F) for application below atmospheric pressure

#### Storage

Models 266HSH - 266NSH	Storage temperature limits
Storage limits	-50 and 85 °C (-58 and 185 °F)
LCD integral display	-40 and 85 °C (-40 and 185 °F)

# Model 266HSH Gauge

# Model 266NSH Absolute

## Environmental limits

### Electromagnetic compatibility (EMC)

Comply with 2014/30/UE to standards EN 61326-1:2013.  
For IEC 61508 SIL certified transmitters EN 61326-3-1:2008.  
For transmitters with option “YE” NAMUR NE 021 (2004).  
Surge immunity level (with surge protector): 4 kV  
(according to IEC 61000-4-5 EN 61000-4-5)

### Pressure equipment directive (PED)

Comply with 2014/68/UE to standards ANSI/ISA 61010-1:2012  
— Category III Module H for PS ≥ than 20 MPa, 200 bar  
— Sound Engineering Practice (SEP) for PS < 20 MPa, 200 bar

### Humidity

Relative humidity: up to 100 %  
Condensing, icing: admissible

### Vibration resistance

Accelerations up to 2 g at frequency up to 1000 Hz  
(according to IEC 60068-2-6)

### Shock resistance

Acceleration: 50 g  
Duration: 11 ms  
(according to IEC 60068-2-27)

### Wet and dust-laden atmospheres

The transmitter is dust and sand tight and protected against immersion effects as defined by IEC 60529 (2001) to IP 67 (IP 68 on request) or by NEMA Type 4X.  
IP65 with Harting Han connector.  
Aluminium and AISI housings as barrel version also comply to IP 66 as defined by IEC 60529 (2001).

## Hazardous atmospheres

### (FOR ALL VERSIONS EXCEPT WirelessHART)

With or without integral display

INTRINSIC SAFETY Ex ia:

ATEX Europe (code E1) approval

II 1 G Ex ia IIC T6...T4 Ga and II 1/2 G Ex ia IIC T6...T4 Ga/Gb and

II 1 D Ex IIIC T85 °C Da and II 1/2 D Ex ia IIIC T85 °C Da/Db.

IECEx (code E8) approval

Ex ia IIC T6...T4 Ga and Ex ia IIIC T85 °C DA.

NEPSI China (code EY)

Ex ia IIC T4~T6, DIP A20TA, T4~T6.

EXPLOSION PROOF:

ATEX Europe (code E2) approval

II 1/2 G Ex db IIC T6 Ga/Gb IP67 Ta=-50 °C to +75 °C and

II 1/2 Ex tb IIIC T85 °C Db IP67 Ta = -50 °C to +75 °C.

IECEx (code E9) approval

Ex db IIC T6 Ga/Gb IP67 Ta=-50 °C to +75 °C and

Ex tb IIIC T85 °C Db IP67 Ta = -50 °C to +75 °C.

NEPSI China (code EZ)

Ex d IIC T6, DIP A21TA, T6.

INTRINSIC SAFETY Ex ic:

ATEX Europe (code E3 ) type examination

II 3 G Ex ic IIC T6...T4 Gc and II 3 D Ex tc IIIC T85 °C Dc.

IECEx (code ER) type examination

Ex ic IIC T6...T4 Gc and Ex tc IIIC T85 °C Dc.

NEPSI China (code ES) type examination

Ex nL IIC T4~T6, DIP A22TA, T6.

FM Approvals US (code E6) and FM Approvals Canada (code E4):

— Explosionproof (US): Class I, Div. 1, Groups A, B, C, D

— Explosionproof (Canada): Class I, Div. 1, Groups B, C, D

— Dust ignitionproof : Class II, Div. 1, Groups E, F, G

— Suitable for: Class II, Div. 2, Groups F, G; Class III, Div.1, 2

— Nonincendive: Class I, Div. 2, Groups A, B, C, D

— Intrinsically safe: Class I, II, III, Div. 1, Groups A, B, C, D, E, F, G

Class I, Zone 0 AEx ia IIC T6/T4, Zone 0 (FM US)

Class I, Zone 0 Ex ia IIC T6/T4, Zone 0 (FM Canada)

COMBINED ATEX (code EW = E1 + E2 + E3), (code E7 = E1 + E2)

COMBINED ATEX, FM and IECEx Approvals (code EN = EW + E4 + E6+ EI)

COMBINED FM Approvals US and Canada

— Intrinsically safe (code EA)

— Explosionproof (code EB)

— Nonincendive (code EC)

COMBINED IECEx (code EH = E8 + E9), (code EI = E8 + E9 + ER)

COMBINED NEPSI (code EP = EY + EZ), (code EQ = EY + EZ + ES)

Technical Regulations Customs Union EAC (Russia, Kazakhstan, Belarus),

Inmetro (Brazil), Kosha (Korea).

## Hazardous atmospheres

### (ONLY FOR WirelessHART VERSION)

With or without integral display

---

INTRINSIC SAFETY:

ATEX Europe (code E1) approval

II 1 G Ex ia IIC T4 and II 1/2 G Ex ia IIC T4.

IECEX (code E8) approval

Ex ia IIC T4.

---

FM Approvals US and FM Approvals Canada:

— Intrinsically safe: Class I, Div. 1, Groups A, B, C, D (code EA)

Class I, Zone 0 AEx ia IIC T4 (FM US)

Class I, Zone 0 Ex ia IIC T4 (FM Canada)

---

COMBINED ATEX, IECEX and FM Approvals US and Canada

(Code EF = E1 + E8 + EA)

---

REFER TO CERTIFICATES FOR AMBIENT TEMPERATURE  
RANGES (WITHIN THE LIMITS OF -50 TO 70°C) RELATED TO  
THE DIFFERENT TEMPERATURE CLASSES

# Model 266HSH Gauge Model 266NSH Absolute

## Electrical Characteristics and Options

### Optional indicators

#### Integrated digital display

(code LS; only with HART standard functionality)

Wide screen LCD, 128 x 64 pixel,  
52.5 x 27.2 mm (2.06 x 1.07 in.) dot matrix.  
Two keys for zero/span or without keypad.  
User selectable application-specific  
visualizations.

Display may also indicate static pressure,  
sensor temperature and diagnostic messages.



#### Integral display with integral keypad

(code L1; not with HART standard functionality)

Wide screen LCD, 128 x 64 pixel,  
52.5 x 27.2 mm (2.06 x 1.07 in.) dot matrix.  
Multilanguage. Four keys for configuration  
and management of device.  
Easy setup for quick commissioning.  
User selectable application-specific  
visualizations.

Totalized and instantaneous flow indication.

Display may also indicate static pressure, sensor temperature  
and diagnostic messages and provides configuration facilities.



#### Integral display with Through-The-Glass (TTG) activated keypad (code L5; not with HART standard functionality)

As above integral display but equipped  
with the innovative TTG keypad allowing  
the activation of the configuration and  
management menus of the device without  
the need of removing the transmitter  
housing cover. TTG keypad is protected  
against accidental activations.



### Optional surge protection

Up to 4kV

- voltage 1.2  $\mu$ s rise time / 50  $\mu$ s delay time to half value
- current 8  $\mu$ s rise time / 20  $\mu$ s delay time to half value

### Process diagnostics (PILD)

Plugged impulse line detection (PILD) generates a warning via  
communication (HART, PA, FF). The device can be configured  
to drive the output to "Alarm current" or set a status "BAD".

### HART® digital communication and 4 to 20 mA output Standard and Advanced functionality

Device type: 1a06<sub>hex</sub> (listed with HCF)

### Power supply

The transmitter operates from 10.5 to 42 V DC with no load  
and is protected against reverse polarity connection  
(additional load allows operations over 42 V DC).

For Ex ia and other intrinsically safe approval power supply  
must not exceed 30 V DC. Minimum operating voltage  
increases to 12.3 V DC with optional surge protector or to  
10.8 V DC with optional conformity to NAMUR NE 21 (2004).

### Ripple

20 mV max on a 250  $\Omega$  load as per HART specifications.

### Load limitations

4 to 20 mA and HART total loop resistance :

$$R \text{ (k}\Omega\text{)} = \frac{\text{Supply voltage} - \text{min. operating voltage (V DC)}}{22 \text{ mA}}$$

A minimum of 250  $\Omega$  is required for HART communication.

### Output signal

Two-wire 4 to 20 mA, user-selectable for linear or 22 points  
linearization table (i.e. for horizontal or spherical tank level  
measurement).

HART® communication provides digital process variable  
superimposed on 4 to 20 mA signal, with protocol based on  
Bell 202 FSK standard.

HART revision 5 is the default HART output.

HART revision 7 is available on request.

### Output current limits (to NAMUR NE 43 standard)

Overload condition

- Lower limit: 3.8 mA (configurable from 3.8 to 4 mA)
- Upper limit: 20.5 mA (configurable from 20 to 21 mA)

Alarm current

- Lower limit: 3.6 mA (configurable from 3.6 to 4 mA)
- Upper limit: 21 mA (configurable from 20 to 23 mA,  
limited to 22 mA for HART Safety;  
apply for electronics release 7.1.15 or later)

Factory setting: high alarm current

### IEC 62591 WirelessHART® output

Device type: 1a06<sub>hex</sub> (listed with HCF)

Network ID: ABB<sub>hex</sub> (2747 decimal)

Join keys: 57495245<sub>hex</sub> (1464422981) 4c455353<sub>hex</sub> (1279611731)  
4649454c<sub>hex</sub> (1179206988) 444b4559<sub>hex</sub> (1145783641).

### Power Supply

1x D-cell size lithium-thionyl chloride battery.

Battery life: 10 years at 32 sec. update time, 8 years at 16 sec. update time or 5 years at 8 sec. update time.

(at reference conditions of 25 ± 2 °C ambient temperature, data routed from 3 additional devices, LCD off).

THE BATTERY CAN BE REPLACED IN FIELD, ALSO IN HAZARDOUS CLASSIFIED AREA.

### Output signal

IEC 62591 WirelessHART Version 7.5 (IEEE 802.15.4-2006);

Frequency band: 2.4 GHz DSSS

Update rate: user selectable from 1 sec. to 60 min.

### Integrated adjustable omnidirectional antenna

— Output radio frequency: maximum 10 mW (10 dBm) EIRP

— Range: up to 300 m. (328 yds.)

Minimum distance between antenna and person is 0.2 m. (8 in.)

### Telecommunications directive

Every wireless measuring device must be certified in accordance with the telecommunications directive, in this case the frequency range. This certification is country-specific.

### European directives

Radio Equipment & Telecommunications Terminal Equipment Directive 2014/53/UE to standards EN 60950-1:2013, EN 62311:2008, EN 301 489-1 V1.9.2, EN 301 489-17 V2.2.1, EN 300 328 v1.8.1.

In Europe, use of the 2400 - 2483.5 MHz frequency band is not harmonized. Country-specific regulations must be observed.

### Restrictions for Norway

Operation not permitted within a radius of 20 km around Ny-Alesund in Svalbard. For more information, see [www.npt.no](http://www.npt.no) Norway Posts and Telecommunications site

### USA / Canadian directives

FCC Part 15.247:2009 (USA)

IC RSS-210 and ICES-003 (Canada)

### PROFIBUS® PA output

#### Device type

Pressure transmitter compliant to Profiles 3.0.1

Identification number: 3450<sub>hex</sub>

#### Power supply

The transmitter operates from 9 to 32 V DC , polarity independent, with or without surge protector.

For Ex ia approval power supply must not exceed 17.5 V DC.

Intrinsic safety installation according to FISCO model.

#### Current consumption

operating (quiescent): 15 mA

fault current limiting: 20 mA max.

#### Output signal

Physical layer in compliance to IEC 61158-2/EN 61158-2.

Transmission to Manchester II modulation, at 31.25 kbit/s.

#### Output interface

PROFIBUS PA communication according to Profibus DP50170 Part 2/DIN 19245 part 1-3.

#### Output update time

25 ms

#### Data blocks

3 analog input, 1 physical.

#### Additional blocks

1 Pressure with calibration transducer block

1 Advanced Diagnostics transducer block including Plugged Input Line Detection

1 Local Display transducer block

#### Transmitter failure mode

On gross transmitter failure condition, detected by self-diagnostics, the output signal can be driven to defined conditions, selectable by the user as safe, last valid or calculated value.

If electronic failure or short circuit occur the transmitter consumption is electronically limited at a defined value (20 mA approx), for safety of the network.

# Model 266HSH Gauge

# Model 266NSH Absolute

## FOUNDATION Fieldbus™ output

### Device type

LINK MASTER DEVICE

Link Active Scheduler (LAS) capability implemented.

Manufacturer code: 000320<sub>hex</sub>

Device type code: 0007<sub>hex</sub>

### Power supply

The transmitter operates from 9 to 32 V DC, polarity independent, with or without surge protector.

For Ex ia approval power supply must not exceed 24 V DC (FF-816 certification) or 17.5 V DC (FISCO certification).

### Current consumption

operating (quiescent): 15 mA

fault current limiting: 20 mA max.

### Output signal

Physical layer in compliance to IEC 61158-2/EN 61158-2.

Transmission to Manchester II modulation, at 31.25 kbit/s.

### Function blocks/execution period

3 enhanced Analog Input blocks/25 ms max (each)

1 enhanced PID block/40 ms max.

1 standard ARithmetic block/25 ms

1 standard Input Selector block/25 ms

1 standard Control Selector block/25 ms

1 standard Signal Characterization block/25 ms

1 standard Integrator/Totalizer block/25 ms

### Additional blocks

1 enhanced Resource block,

1 custom Pressure with calibration transducer block

1 custom Advanced Diagnostics transducer block including  
Plugged Input Line Detection

1 custom Local Display transducer block

### Number of link objects

35

### Number of VCRs

35

## Output interface

FOUNDATION fieldbus digital communication protocol to standard H1, compliant to specification V. 1.7.

### Transmitter failure mode

The output signal is “frozen” to the last valid value on gross transmitter failure condition, detected by self-diagnostics which also indicate a BAD conditions. If electronic failure or short circuit occur the transmitter consumption is electronically limited at a defined value (20 mA approx), for safety of the network.



## Performance specifications

Stated at reference condition to IEC 60770 ambient temperature of 20 °C (68 °F), relative humidity of 65 %, atmospheric pressure of 1013 hPa (1013 mbar), mounting position with vertical diaphragm and zero based range for transmitter with isolating diaphragms in AISI 316 L ss or Hastelloy and silicone oil fill and HART digital trim values equal to 4 mA and to 20 mA span end points, in linear mode. Unless otherwise specified, errors are quoted as % of span. Some performance referring to the Upper Range Limit are affected by the actual turndown (TD) as ratio between Upper Range Limit (URL) and calibrated span.

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

### Dynamic performance (according to IEC 61298–1 definition)

Sensors	Time constant (63.2 % of total step change)
Sensor M to S	≤ 70 ms
Sensor H	100 ms
Sensor F	180 ms
Sensor W	150 ms
Sensor Z	≤ 80 ms
Dead time for all sensors	30 ms

Response time (total) = dead time + time constant.

See "Update Rate" for WirelessHART version.

### Accuracy rating

% of calibrated span, including combined effects of terminal based linearity, hysteresis and repeatability.

For fieldbus versions SPAN refer to analog input function block outscale range

Model	Sensor	for TD	
266HSH	F to Q	from 1:1 to 10:1	± 0.06 %
	F to Q	from 10:1 to 100:1	± (0.006 x TD) %
	S, E	from 1:1 to 10:1	± 0.075 %
	S	from 10:1 to 100:1	± (0.0075 x TD) %
	E	from 10:1 to 30:1	± (0.0075 x TD) %
	W	from 1:1 to 5:1	± 0.075 %
	W	from 5:1 to 50:1	± (0.015 x TD) %
	Z	from 1:1 to 5:1	± 0.15 %
266HSH (option D2)	Z	from 5:1 to 10:1	± (0.03 x TD) %
	F to Q	from 1:1 to 5:1	± 0.04 %
266NSH	F to Q	from 5:1 to 100:1	± (0.0105 + 0.0059 x TD) %
	F to S	from 1:1 to 10:1	± 0.075 %
	F to S	from 10:1 to 60:1	± (0.0075 x TD) %

### Ambient temperature

per 20K change between the limits of –40 °C to +85 °C  
(per 36 °F change between the limits of –40 to +185 °F):

Model	Sensor	for TD up to	
266HSH	F to Q	10:1	± (0.03 % URL + 0.045 % span)
	E and S	10:1	± (0.04 % URL + 0.065 % span)
	W	5:1	± (0.04 % URL + 0.065 % span)
	Z	10:1	± (0.06 % URL + 0.10 % span)
266NSH	F to Q	10:1	± (0.06 % URL + 0.09 % span)
	S	10:1	± (0.08 % URL + 0.13 % span)

for an ambient temperature change from –10 °C to +60 °C  
(+14 to +140 °F):

Model	Sensor	for TD up to	
266HSH	F to Q	10:1	± (0.055 % URL + 0.08 % span)
	E and S	10:1	± (0.075 % URL + 0.11 % span)
	W	5:1	± (0.075 % URL + 0.11 % span)
	Z	10:1	± (0.10 % URL + 0.15 % span)
266NSH	F to Q	10:1	± (0.11 % URL + 0.16 % span)
	S	10:1	± (0.15 % URL + 0.22 % span)

per 10K change between the limits of –40 °C to –10 °C or +60° to +85 °C (per 18 °F change between the limits of –40 to +14 °F or +140° to +185 °F):

Model	Sensor	for TD up to	
266HSH	F to Q	10:1	± (0.03 % URL + 0.04 % span)
	E and S	10:1	± (0.04 % URL + 0.055 % span)
	W	5:1	± (0.04 % URL + 0.055 % span)
	Z	10:1	± (0.06 % URL + 0.10 % span)
266NSH	F to Q	10:1	± (0.055 % URL + 0.08 % span)
	S	10:1	± (0.075 % URL + 0.11 % span)

# Model 266HSH Gauge

# Model 266NSH Absolute

## Supply voltage

Within voltage/load specified limits the total effect is less than 0.005 % of URL per volt.

## Load

Within load/voltage specified limits the total effect is negligible.

## Electromagnetic field

Meets all the requirements of EN 61326 for surge immunity level (of NAMUR NE 21 on request).

## Common mode interference

No effect from 100Vrms @ 50Hz, or 50 V DC

## Mounting position

No effect for rotation on diaphragm plane. A tilt up to 90° from vertical causes a zero shifts up to 0.5 kPa, 5 mbar or 2 inH2O, which can be corrected with zero adjustment. No span effect.

## Stability

±0.15 % of URL over a ten years period for sensors E to W  
±0.45 % of URL over a three years period for sensor Z

## Maximum total performance

For temperature change of 28 °C (50 °F) for model 266HSH with accuracy option code D2 (± 0.04 %)

Sensor	Span	Maximum total performance
M	550 kPa, 5,5 bar, 80 psi	≤± 0.120 % of calibrated span
P	2000 kPa, 20 bar, 290 psi	
Q	6900 kPa, 69 bar, 1000 psi	

$$E_{\text{Mperf}} = \sqrt{(E_{\Delta Tz} + E_{\Delta Ts})^2 + E_{\text{lin}}^2}$$

$E_{\text{Mperf}}$  = Maximum total performance

$E_{\Delta Tz}$  = Effect of the ambient temperature on zero

$E_{\Delta Ts}$  = Effect of the ambient temperature on span

$E_{\text{lin}}$  = Accuracy rating (for terminal-based linearity 0.04 %)

## Total performance

similar to DIN 16086

Temperature change in the range from -10 to 60 °C (14 to 140 °F)

Model	Sensor	TD	Total performance
266HSH, D2 option	F to Q	1:1	≤± 0.14 % of calibrated span
266NSH	F to Q	1:1	≤± 0.28 % of calibrated span

$$E_{\text{perf}} = \sqrt{(E_{\Delta Tz} + E_{\Delta Ts})^2 + E_{\text{lin}}^2}$$

$E_{\text{perf}}$  = Total Performance

$E_{\Delta Tz}$  = Effect of the ambient temperature on zero

$E_{\Delta Ts}$  = Effect of the ambient temperature on span

$E_{\text{lin}}$  = Accuracy rating (for terminal-based linearity 0.04 % or 0.075% as per model/sensor accuracy)

Maximum total performance and Total performance includes the measuring errors of

- non-linearity including hysteresis and non-reproducibility,
- thermal change of the ambient temperature as regards the zero signal and the calibrated span,

## Physical Specification

(Refer to ordering information sheets for variant availability related to specific model or versions code)

### Materials

#### Process isolating diaphragms (\*)

AISI 316 L ss; AISI 316 L ss gold plated;  
Hastelloy® C-276; Monel 400®; Tantalum; (sensors E to S).  
AISI 316 L ss; Hastelloy® C-276; (sensor W).  
Inconel 718 (sensor Z).

#### Process connection (\*)

AISI 316 L ss; Hastelloy® C-276; Monel 400® (sensors F to S).  
AISI 316 L ss; Hastelloy® C-276; (sensor W).  
Inconel® 718 (sensor Z) with cone in Inconel® 625 for F250C connection only.

#### Sensor fill fluid

Silicone oil; Inert fill (Halocarbon® 4.2 or Galden®).

#### Mounting bracket (\*\*)

Zinc plated carbon steel with chrome passivation; AISI 316 L ss.

#### Sensor housing

AISI 316 L ss.

### Electronic housing and covers

Aluminium alloy (copper content  $\leq 0.3$  %) with baked epoxy finish (colour RAL9002); AISI 316 L ss;  
AISI 316 L ss with two components epoxy mastic coated with acrylic epoxy finish (colour aluminium grey), with antistatic agents according to CEI EN 60079.

#### Covers O-ring

Buna N.

#### Local adjustments (zero, span and write protect)

For Standard HART version:

- Internal for zero and span (on communication board)
- External non-intrusive for zero, span and write protect in glass filled polyphenylene oxyde, removable (code R1).

For all other versions:

- External non-intrusive for zero, span and write protect in glass filled polyphenylene oxyde, removable.

#### Plates

Transmitter nameplate: AISI 316 ss screwed to the electronics housing.

Certification plate and optional tag/calibration plate : self-adhesive attached to the electronics housing or AISI 316 ss fastened to the electronics housing with rivets or screws.

Optional wired-on customer data plate: AISI 316 ss.

Laser printing on metal or thermal printing on self-adhesive.

For AISI 316 L ss housing it is mandatory to select option I2 or I3 for plates in AISI 316 ss.

#### Calibration

Standard: at maximum span, zero based range, ambient temperature and pressure;

Optional: at specified range and ambient conditions.

(\*) Wetted parts of the transmitter.

(\*\*) U-bolt material: high-strength alloy steel or AISI 316 L ss;  
bolts/nuts material: high-strength alloy steel or AISI 316 ss.

# Model 266HSH Gauge

# Model 266NSH Absolute

## Optional extras

### Mounting brackets (code Bx)

For 60mm. (2in) pipes or wall mounting.

### Display (code Lx)

4-position (at 90°) user orientable.

### Optional plates (code Ix)

Code I2: AISI 316 ss plate with laser printed tag (up to 31 characters) and calibration details (up to 31 characters: lower and upper range values and engineering unit) fixed onto transmitter housing.

Code I1: AISI 316 ss wired-on plate with laser printed customized data (4 lines of 32 characters with 4 mm/0.16 in. height).

### Surge protection (code S2)

### Cleaning procedure for oxygen service (code P1)

### Test Certificates (test, design, calibration, material traceability) (codes Cx and Hx)

### Tag and manual language (codes Tx and Mx)

### Communication connectors (code Ux)

### Manifold mounting (code A1)

Factory mounting and pressure test of ABB M26 manifolds.

## Process connections

### For sensors F to S

$\frac{1}{2}$  in. – 14 NPT male or female; DIN EN837-1 G  $\frac{1}{2}$  B; adapter straight (180°) entry; adapter angle (90°) entry.

### For sensor W

$\frac{1}{2}$  in. – 14 NPT male or female.

### For sensor Z

$\frac{1}{4}$  in. – 18 NPT female; F250C (autoclave).

## Electrical connections

Two  $\frac{1}{2}$  in. – 14 NPT or M20x1.5 threaded conduit entries, direct on housing. Only M20x1.5 for WirelessHART with one port used for antenna.

Special communication connector (on request)

— HART: straight or angle Harting Han 8D connector and one plug.

— FOUNDATION Fieldbus, PROFIBUS PA: M12x1 or 7/8 in.

## Terminal block

HART version: three terminals for signal/external meter wiring up to 2.5 mm<sup>2</sup> (14 AWG), also connection points for test and communication purposes.

WirelessHART version: connection points for test and communication purposes; additional fast connection for external harvesting unit.

Fieldbus versions: two terminals for signal wiring (bus connection) up to 2.5 mm<sup>2</sup> (14 AWG)

## Grounding

Internal and external 6 mm<sup>2</sup> (10 AWG) ground termination points are provided.

## Mounting position

Transmitter can be mounted in any position.

Electronics housing may be rotated to any position. A positive stop prevents over travel.

## Mass (without options)

2.1 kg approx (4.6 lb); add 1.5 kg (3.3 lb) for AISI housing. Add 650 g (1.5 lb) for packing.

## Packing

Carton 27 x 24 x 20 cm approx (11 x 10 x 8 in.);

Carton 28 x 28 x 24 cm approx (11 x 11 x 10 in.) for WirelessHART version.

## Configuration

### Transmitter with HART communication and 4 to 20 mA Standard configuration

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the tag plate. If a calibration range and tag data are not specified, the transmitter will be supplied with the plate left blank and configured as follows:

Engineering Unit	kPa
4 mA	Zero
20 mA	Upper Range Limit (URL)
Output	Linear
Damping	1 s
Transmitter failure mode	Upscale
Software tag (8 characters max)	Blank
Optional LCD display	PV in kPa; output in mA and in percentage on bargraph

Any or all the above configurable parameters, including Lower range-value and Upper range-value which must be the same unit of measure, can be easily changed using the HART hand-held communicator or by a PC running the configuration software with DTM for 266 models. The transmitter database is customized with specified flange type and material, O-ring and drain/vent materials and meter code option.

### Custom configuration (option N6)

The following data may be specified in addition to the standard configuration parameters:

Descriptor	16 alphanumeric characters
Message	32 alphanumeric characters
Date	Day, month, year

For HART protocol available engineering units of pressure measure are :

Pa, kPa, MPa

inH<sub>2</sub>O@4 °C, mmH<sub>2</sub>O@4 °C, psi

inH<sub>2</sub>O@20 °C, ftH<sub>2</sub>O@20 °C, mmH<sub>2</sub>O@20 °C

inHg, mmHg, Torr

g/cm<sup>2</sup>, kg/cm<sup>2</sup>, atm

mbar, bar

These and others are available for PROFIBUS and FOUNDATION Fieldbus.

### Transmitter with WirelessHART communication

#### Standard configuration

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the tag plate. If a calibration range and tag data are not specified, the transmitter will be supplied with the plate left blank and configured as follows:

Engineering Unit	kPa
Output scale 0 %	Lower Range Limit (LRL)
Output scale 100 %	Upper Range Limit (URL)
Output	Linear
Update time	16 s
Software tag (8 characters max)	Blank
Optional LCD display	PV in kPa; output in percentage on bargraph

Any or all the above configurable parameters, including Lower range-value and Upper range-value which must be the same unit of measure, can be easily changed using the HART hand-held communicator or by a PC running the configuration software with DTM for 266 models. The transmitter database is customized with specified flange type and material, O-ring and drain/vent materials and meter code option.

### Custom configuration (option N6)

The following data may be specified in addition to the standard configuration parameters:

Descriptor	16 alphanumeric characters
Message	32 alphanumeric characters
Date	Day, month, year

# Model 266HSH Gauge

# Model 266NSH Absolute

## Transmitter with PROFIBUS PA communication

### Standard configuration

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the tag plate. If a calibration range and tag data are not specified, the transmitter will be supplied with the plate left blank and configured as follows:

Measure Profile	Pressure
Engineering Unit	kPa
Output scale 0 %	Lower Range Limit (LRL)
Output scale 100 %	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5 % of output scale
PV filter	0 s
Address (set by local key)	126
Tag	32 alphanumeric characters
Optional LCD display	PV in kPa; output in percentage on bargraph

Any or all the above configurable parameters, including the range values which must be the same unit of measure, can be easily changed by a PC running the configuration software with DTM for 266 models. The transmitter database is customized with specified flange type and material, O-ring and drain/vent materials and meter code option.

### Custom configuration (option N6)

The following data may be specified in addition to the standard configuration parameters:

Descriptor	32 alphanumeric characters
Message	32 alphanumeric characters
Date	Day, month, year

## Transmitter with FOUNDATION Fieldbus communication

### Standard configuration

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the tag plate. If a calibration range and tag data are not specified, the transmitter will be supplied with the plate left blank and the analog input function block FB1 is configured as follows:

Measure Profile	Pressure
Engineering Unit	kPa
Output scale 0 %	Lower Range Limit (LRL)
Output scale 100 %	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit :	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5 % of output scale
PV filter time	0 s
Tag	32 alphanumeric characters
Optional LCD display	PV in kPa; output in percentage on bargraph

The analog input function block FB2 and FB3 are configured respectively for the sensor temperature measured in °C and for the static pressure measured in MPa.

Any or all the above configurable parameters, including the range values, can be changed using any host compliant to FOUNDATION fieldbus. The transmitter database is customized with specified flange type and material, O-ring and drain/vent materials and meter code option.


### Custom configuration (option N6)

The following data may be specified in addition to the standard configuration parameters:

Descriptor	32 alphanumeric characters
Message	32 alphanumeric characters
Date	Day, month, year


## MOUNTING DIMENSIONS (not for construction unless certified) – dimensions in mm. (in.)

### Transmitter with barrel housing - 1/2 in. NPT female connection for sensor E to S

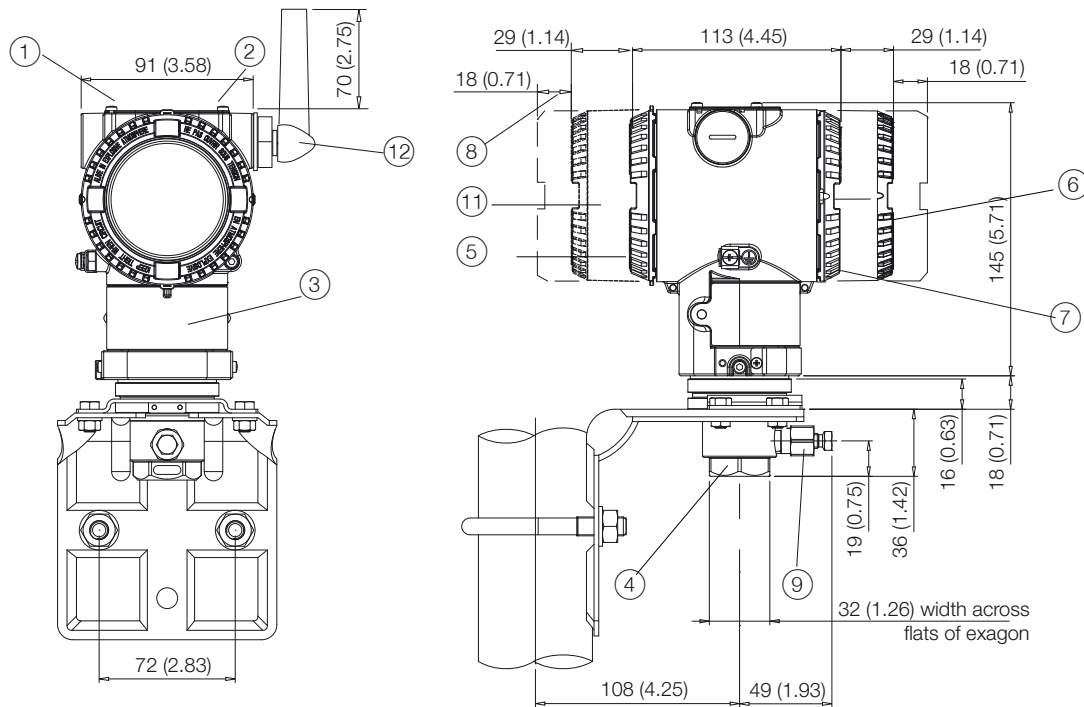

- ① Adjustments | ② Identification plate | ③ Certification plate | ④ Process connection | ⑤ Terminal side | ⑥ L1 and L5 integral display housing | ⑦ Electronic side | ⑧ Space for cover removal | ⑨ Drain/vent valve | ⑪ Battery housing of WirelessHART version | ⑫ Antenna of WirelessHART version


### Transmitter with barrel housing - 1/2 in. NPT female connection for sensor W

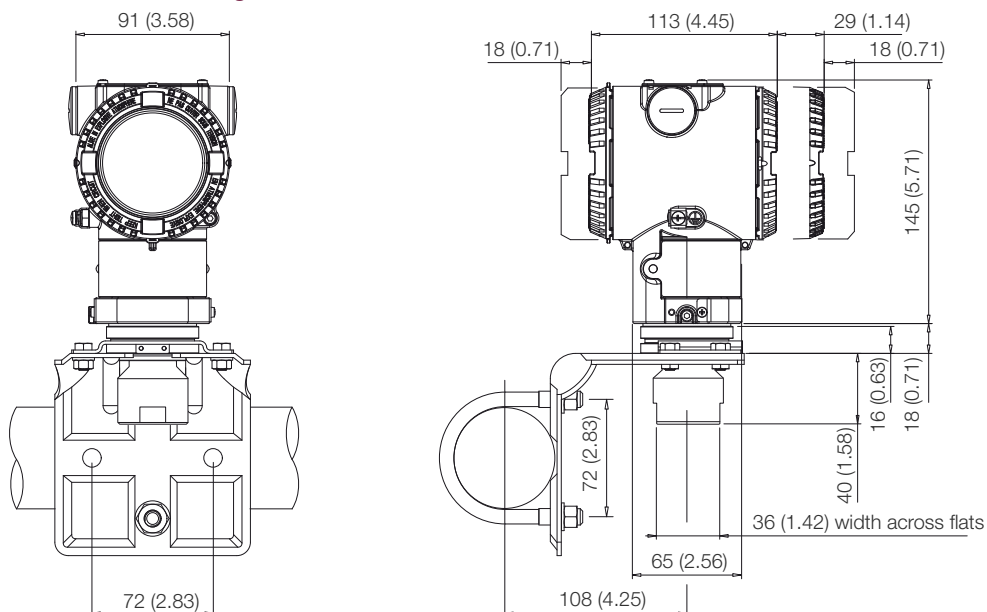


# Model 266HSH Gauge

# Model 266NSH Absolute

Transmitter with barrel housing - F250C female connection for sensor Z

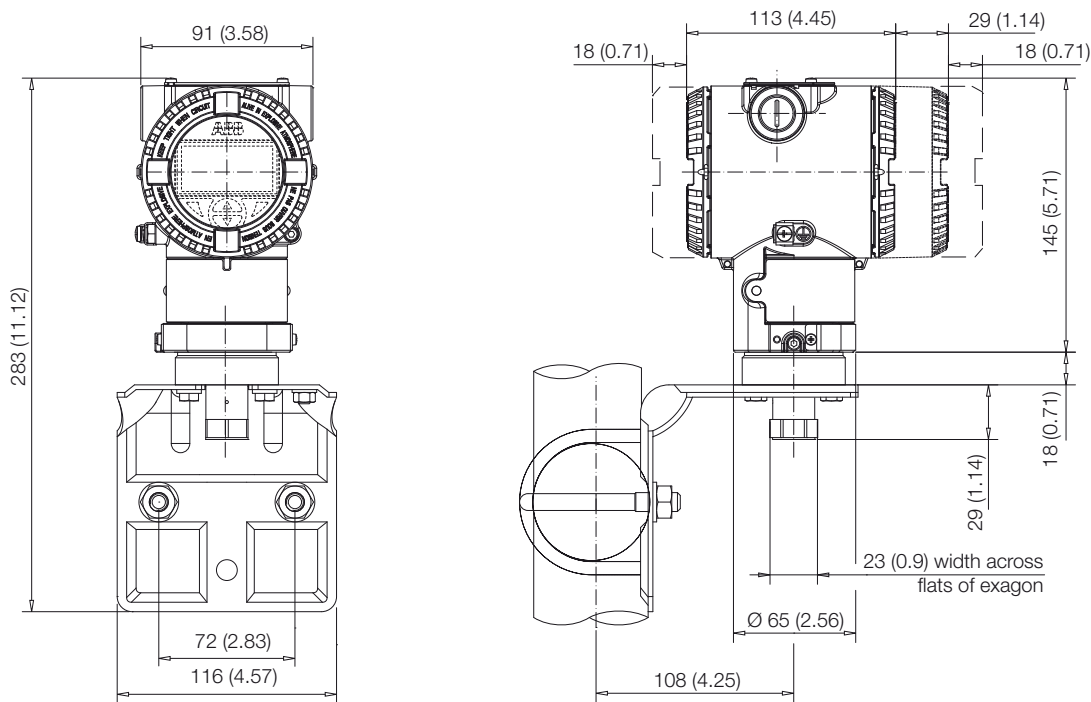


Transmitter with barrel housing - 1/4 in. NPT female connection for sensor Z

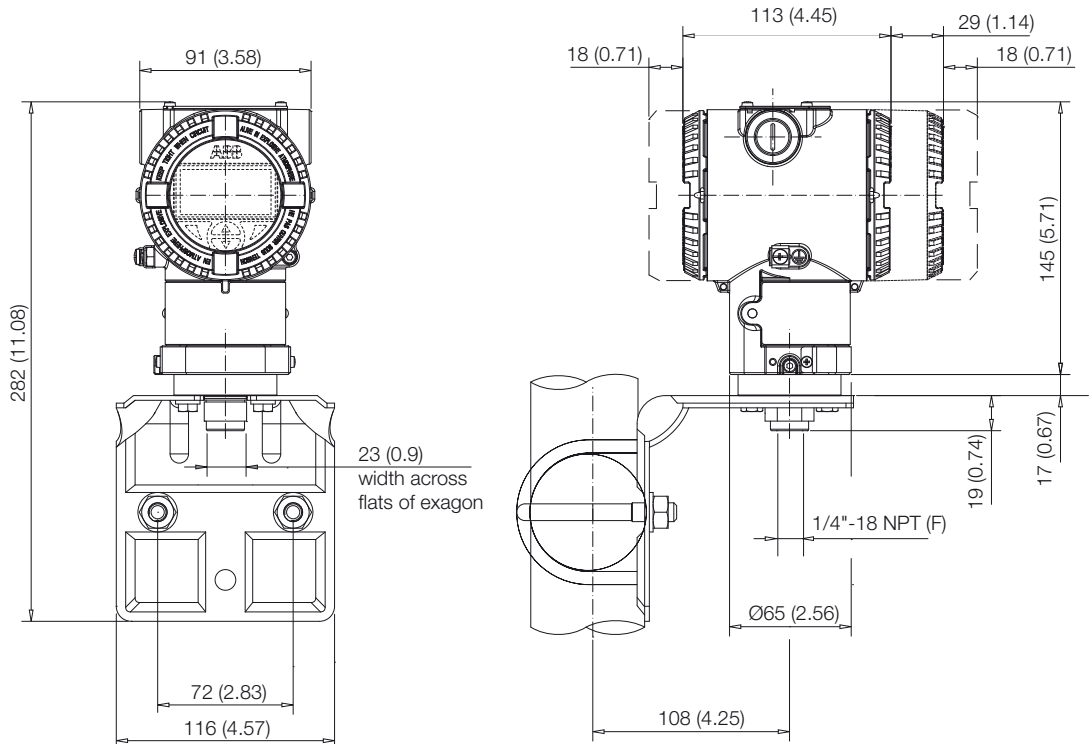




### Transmitter with DIN aluminium housing - 1/2 in. NPT male connection for sensor E to S

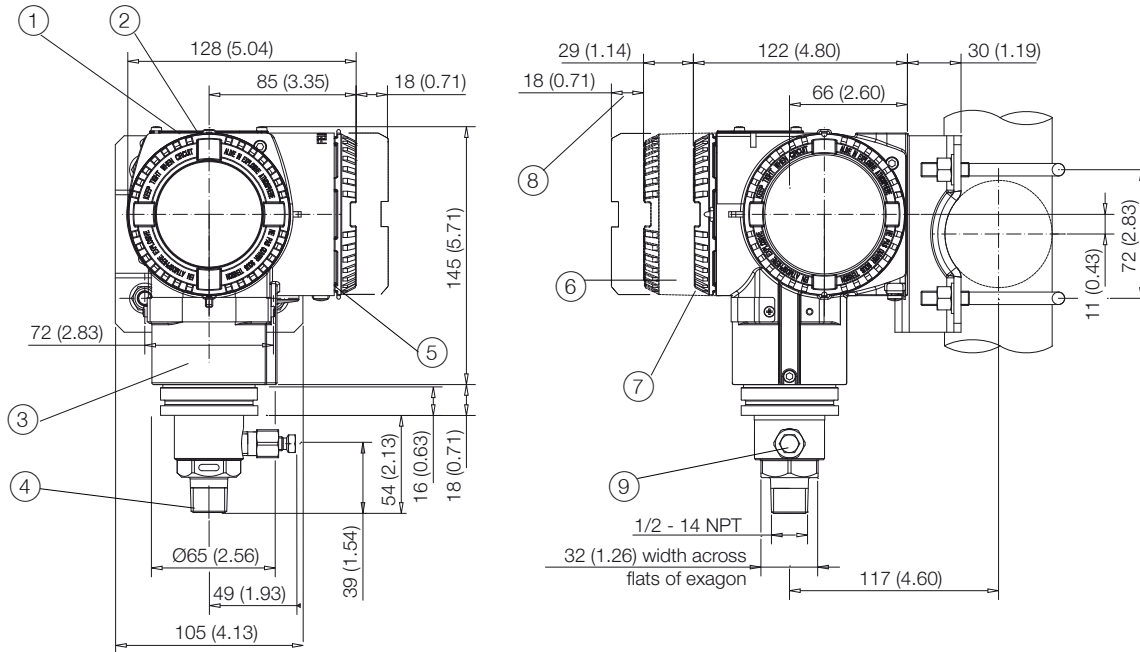

- ① Adjustments | ② Identification plate | ③ Certification plate | ④ Process connection | ⑤ Terminal side | ⑥ Integral display housing | ⑦ Electronic side | ⑧ Space for cover removal | ⑨ Drain/vent valve


### Transmitter with DIN aluminium housing - 1/2 in. NPT male connection for sensor W

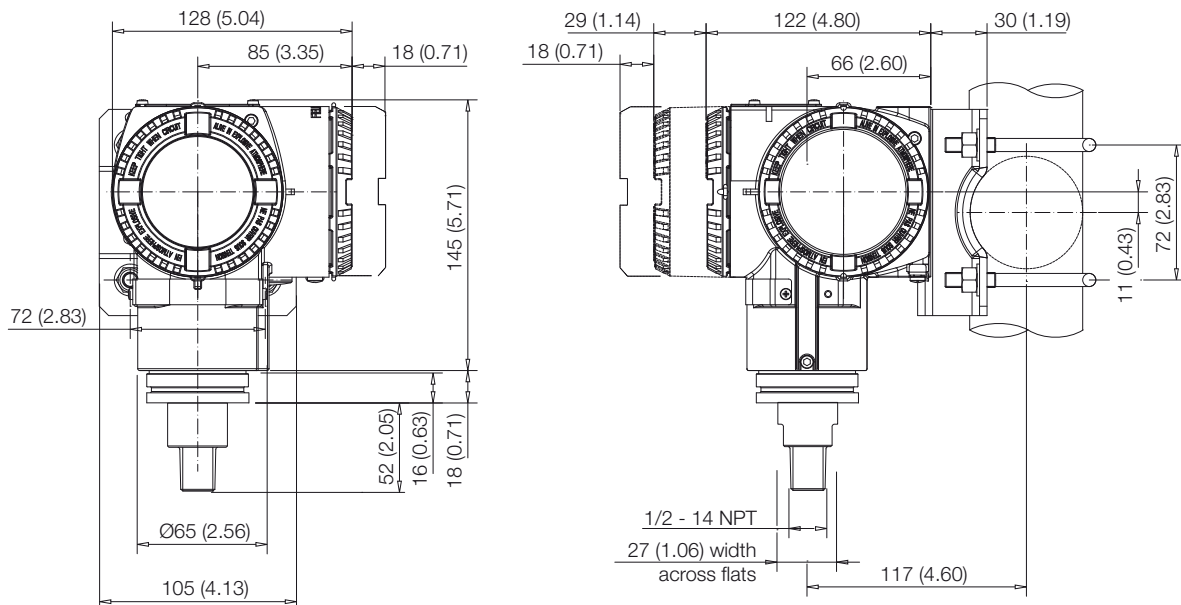


# Model 266HSH Gauge

# Model 266NSH Absolute


Transmitter with barrel housing - DIN-EN837-1 G 1/2 B connection for sensor E to S

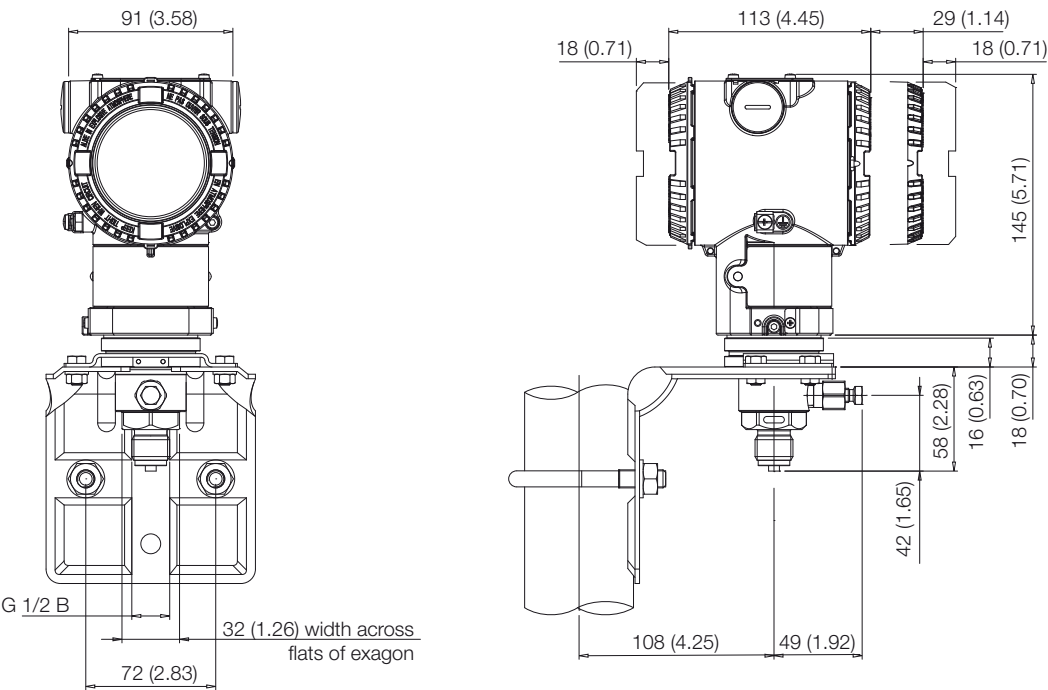

Transmitter with barrel housing - adapter angle (90°) entry connection for sensor E to S

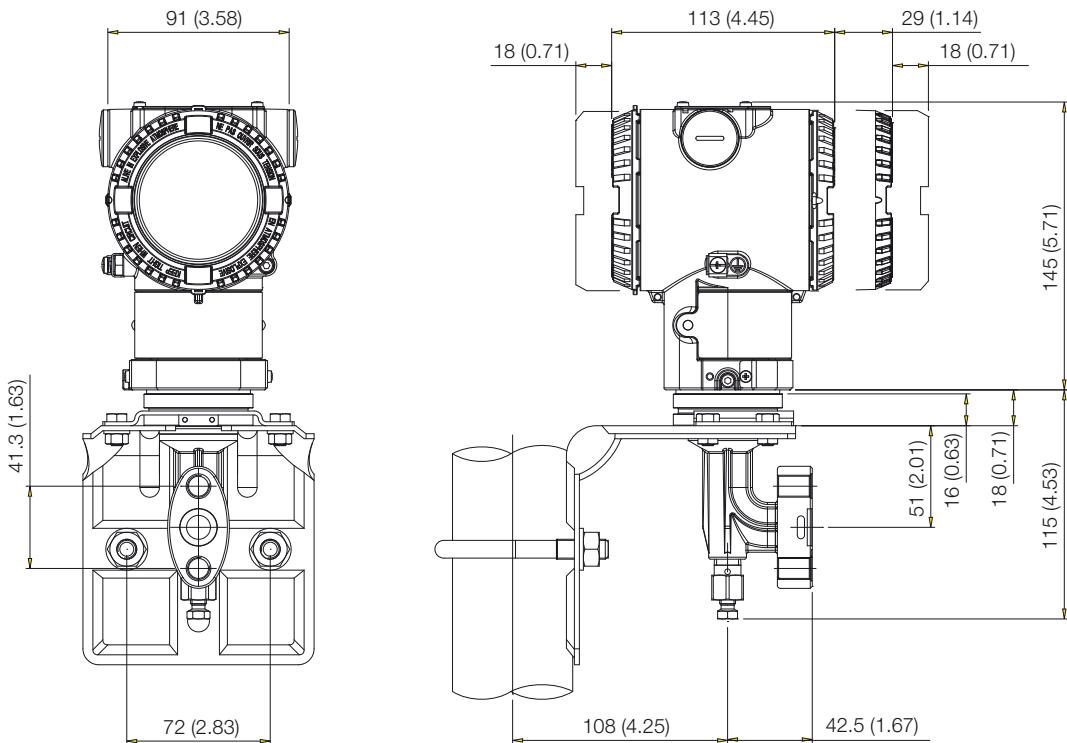

**Transmitter with barrel housing - adapter straight (180°) entry connection for sensor E to S**

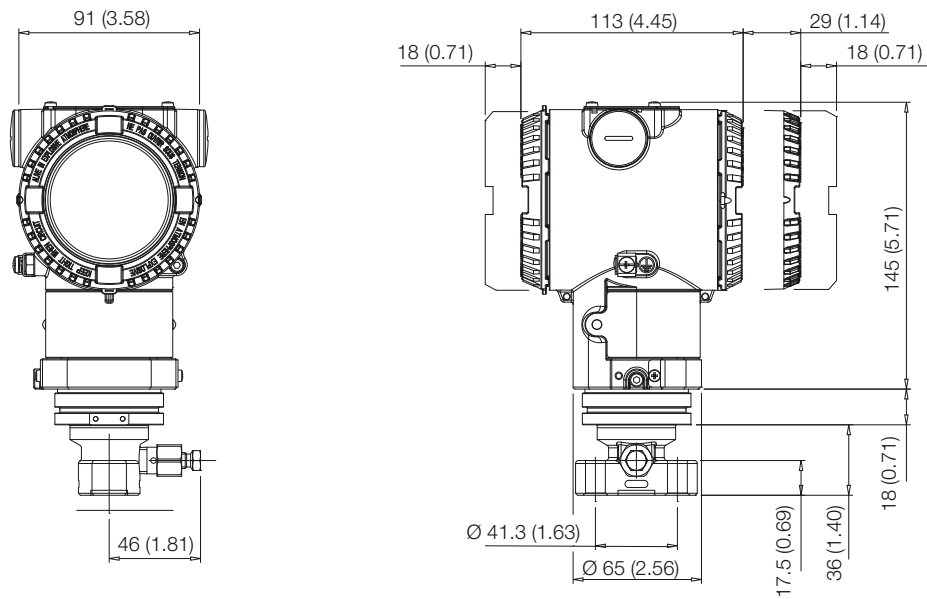


# Model 266HSH Gauge

# Model 266NSH Absolute


## Electrical connections

### HART Version

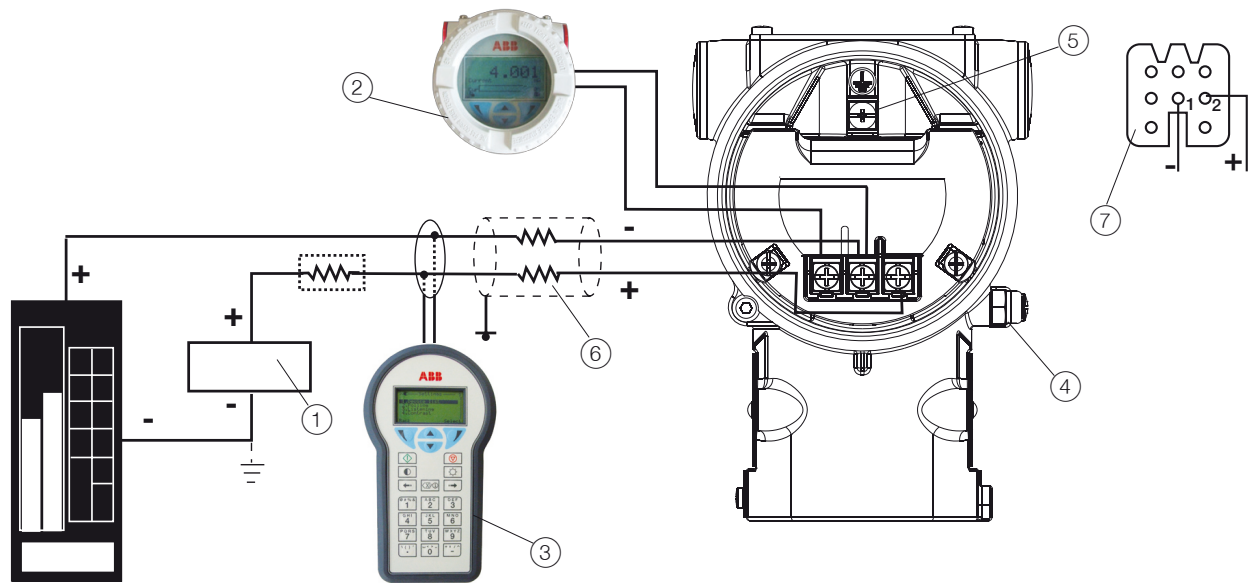


HART hand-held communicator may be connected at any wiring termination point in the loop, providing the minimum resistance is 250 ohm. If this is less than 250 ohm, additional resistance should be added to allow communications. Maximum voltage drop on external remote indicator is 0.7 V DC.

### FIELDBUS Versions

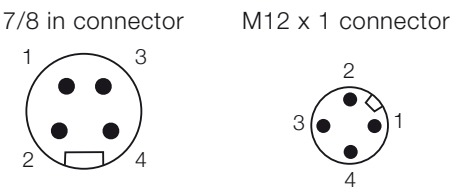


PIN (male) IDENTIFICATION		
	FOUNDATION Fieldbus	PROFIBUS PA
1	DATA -	DATA +
2	DATA +	GROUND
3	SHIELD	DATA -
4	GROUND	SHIELD

CONNECTOR IS SUPPLIED LOOSE  
WITHOUT MATING FEMALE PLUG

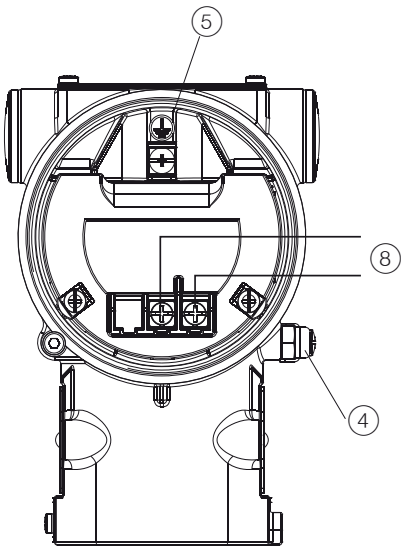

- (1) Power source | (2) Remote indicator | (3) Handheld communicator | (4) External ground termination point | (5) Internal ground termination point | (6) Line load | (7) Harting Han 8D socket insert for mating plug (supplied loose) | (8) Fieldbus line (polarity independent)

## WirelessHART version

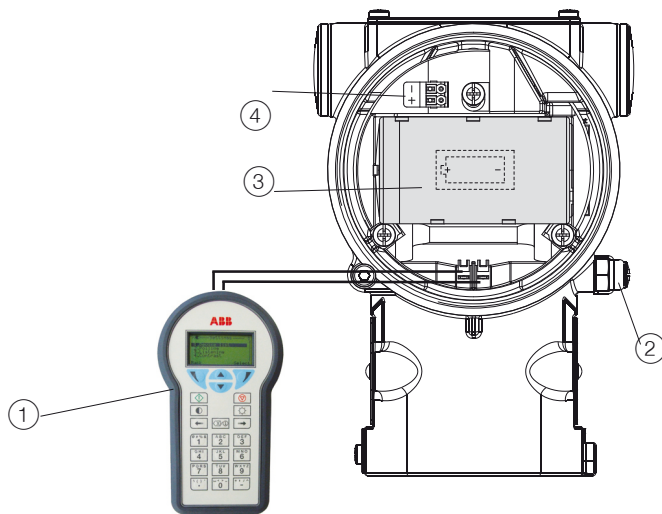

- ① Handheld communicator | ② External ground termination point | ③ Battery | ④ Fast connection for harvesting unit

# Model 266HSH Gauge

# Model 266NSH Absolute

## Ordering information

### BASIC ORDERING INFORMATION model 266HSH Gauge Pressure Transmitter

Select one character or set of characters from each category and specify complete catalog number.

Refer to additional ordering information and specify one or more codes for each transmitter if additional options are required.

BASE MODEL - 1 <sup>st</sup> to 6 <sup>th</sup> characters				2 6 6 H S H	X	X	X	X	X
Gauge Pressure Transmitter – BASE ACCURACY 0.06 %									
SENSOR - Span limits - 7 <sup>th</sup> character									
0.54 and 16 kPa	5.4 and 160 mbar	2.16 and 64 inH2O		E					
0.4 and 40 kPa	4 and 400 mbar	1.6 and 160 inH2O		F					
1.6 and 160 kPa	16 and 1600 mbar	6.4 and 642 inH2O		H					
6 and 600 kPa	0.06 and 6 bar	0.87 and 87 psi		M					
24 and 2400 kPa	0.24 and 24 bar	3.5 and 348 psi		P					
80 and 8000 kPa	0.8 and 80 bar	11.6 and 1160 psi		Q					
160 and 16000 kPa	1.6 and 160 bar	23.2 and 2320 psi		S					
1400 and 70000 kPa	14 and 700 bar	203 and 10150 psi		W					
10500 and 105000 kPa	105 and 1050 bar	1522 and 15225 psi		Z					
Diaphragm material / Fill fluid (wetted parts) - 8 <sup>th</sup> character									
AISI 316 L ss	Silicone oil	(Note 16)	NACE	S					
Hastelloy® C-276	Silicone oil	(Note 16)	NACE	K					
Monel 400®	Silicone oil	(Notes 2, 16)	NACE	M					
AISI 316 L ss gold plated	Silicone oil	(Notes 2, 15, 16)	NACE	8					
Tantalum	Silicone oil	(Notes 2, 16)	NACE	T					
AISI 316 L ss	Inert fluid - Galden	(Notes 1, 2, 16)	NACE	A					
Hastelloy® C-276	Inert fluid - Galden	(Notes 1, 2, 16)	NACE	F					
Monel 400®	Inert fluid - Galden	(Notes 1, 2, 16)	NACE	C					
AISI 316 L ss gold plated	Inert fluid - Galden	(Notes 1, 2, 15, 16)	NACE	9					
Tantalum	Inert fluid - Galden	(Notes 1, 2, 16)	NACE	D					
AISI 316 L ss	Inert fluid - Halocarbon	(Notes 1, 2, 16)	NACE	L					
Hastelloy® C-276	Inert fluid - Halocarbon	(Notes 1, 2, 16)	NACE	P					
Monel 400®	Inert fluid - Halocarbon	(Notes 1, 2, 16)	NACE	4					
AISI 316 L ss gold plated	Inert fluid - Halocarbon	(Notes 1, 2, 15, 16)	NACE	I					
Tantalum	Inert fluid - Halocarbon	(Notes 1, 2, 16)	NACE	5					
Inconel® 718	No filling	(for sensor Z ONLY)	(Notes 2, 3)	NACE	N				

continued  
see next page

BASIC ORDERING INFORMATION model 266HSH Gauge Pressure Transmitter					2 6 6 H S H X X	X	X	X
<b>Process connection (wetted parts) - 9<sup>th</sup> character</b>								
AISI 316 L ss	1/2 in. – 14 NPT female	(Notes 4, 16)	NACE	B				
AISI 316 L ss	1/2 in. – 14 NPT male	(Notes 4, 16)	NACE	T				
AISI 316 L ss	DIN EN837-1 G 1/2 B	(Notes 2, 4, 16)	NACE	P				
AISI 316 L ss	Adapter straight (180°) entry (not available with bracket)	(Notes 2, 4, 16)	NACE	A				
AISI 316 L ss	Adapter angle (90°) entry	(Notes 2, 4, 16)	NACE	N				
Hastelloy® C-276	1/2 in. – 14 NPT female	(Notes 5, 16)	NACE	E				
Hastelloy® C-276	1/2 in. – 14 NPT male	(Notes 5, 16)	NACE	K				
Hastelloy® C-276	DIN EN837-1 G 1/2 B	(Notes 2, 5, 16)	NACE	D				
Hastelloy® C-276	Adapter straight (180°) entry (not available with bracket)	(Notes 2, 5, 16)	NACE	F				
Hastelloy® C-276	Adapter angle (90°) entry	(Notes 2, 5, 16)	NACE	C				
Monel 400®	1/2 in. – 14 NPT female	(Notes 2, 6, 16)	NACE	1				
Monel 400®	1/2 in. – 14 NPT male	(Notes 2, 6, 16)	NACE	2				
Monel 400®	DIN EN837-1 G 1/2 B	(Notes 2, 6, 16)	NACE	3				
Inconel® 718	F250C	(for sensor Z ONLY)	(Notes 2, 3)	NACE	6			
Inconel® 718	1/4 in. – 18 NPT female	(for sensor Z ONLY)	(Notes 2, 3)	NACE	7			
<b>Housing material and electrical connection - 10<sup>th</sup> character</b>								
Aluminium alloy (barrel version)	1/2 in. – 14 NPT		(Note 21)	A				
Aluminium alloy (barrel version)	M20 x 1.5 (CM 20)	(TO BE USED for WirelessHART)		B				
Aluminium alloy (barrel version)	Harting Han 8D connector	(general purpose only)	(Notes 7, 21)	E				
Aluminium alloy (barrel version)	Fieldbus connector	(general purpose only)	(Notes 7, 21)	G				
AISI 316 L ss (barrel version) (I2 or I3 required)	1/2 in. – 14 NPT		(Note 21)	S				
AISI 316 L ss (barrel version) (I2 or I3 required)	M20 x 1.5 (CM20)	(TO BE USED for WirelessHART)		T				
AISI 316 L ss (barrel version) (I2 or I3 required)	Fieldbus connector	(general purpose only)	(Notes 7, 21)	Z				
AISI 316 L ss painted (barrel version) (I2 or I3 required)	1/2 in. – 14 NPT		(Note 21)	C				
AISI 316 L ss painted (barrel version) (I2 or I3 required)	M20 x 1.5 (CM20)	(TO BE USED for WirelessHART)		D				
AISI 316 L ss painted (barrel version) (I2 or I3 required)	Fieldbus connector	(general purpose only)	(Notes 7, 21)	F				
Aluminium alloy (DIN version)	M20 x 1.5 (CM20)	(not Ex d or XP)	(Note 21)	J				
Aluminium alloy (DIN version)	Harting Han 8D connector	(general purpose only)	(Notes 7, 21)	K				
Aluminium alloy (DIN version)	Fieldbus connector	(general purpose only)	(Notes 7, 21)	W				
<b>Output/Additional options - 11<sup>th</sup> character</b>								
HART and 4 to 20 mA - Standard functionality	No additional options		(Notes 16, 8, 9)	L				
HART and 4 to 20 mA - Standard functionality	Options requested by "Additional ordering code"		(Note 16, 8)	7				
HART and 4 to 20 mA - Advanced functionality (includes option R1)	No additional options		(Notes 8, 9)	H				
HART and 4 to 20 mA - Advanced functionality (includes option R1)	Options requested by "Additional ordering code"		(Note 8)	1				
PROFIBUS PA (includes option R1)	No additional options		(Notes 8, 9)	P				
PROFIBUS PA (includes option R1)	Options requested by "Additional ordering code"		(Note 9)	2				
FOUNDATION Fieldbus (includes option R1)	No additional options		(Notes 8, 9)	F				
FOUNDATION Fieldbus (includes option R1)	Options requested by "Additional ordering code"		(Note 9)	3				
HART and 4 to 20 mA Safety, certified to IEC 61508 (includes option R1)	No additional options		(Notes 8, 9)	T				
HART and 4 to 20 mA Safety, certified to IEC 61508 (includes option R1)	Options requested by "Additional ordering code"		(Note 8)	8				
WirelessHART (includes option R1)	No additional options		(Notes 16, 20)	W				
WirelessHART (includes option R1)	Options requested by "Additional ordering code"		(Notes 16, 20)	9				

NOTE - Option R1 represents the external pushbuttons

# Model 266HSH Gauge

# Model 266NSH Absolute

## ADDITIONAL ORDERING INFORMATION for model 266HSH

Add one or more 2-digit code(s) after the basic ordering information to select all required options

			XX	XX	XX
<b>Accuracy</b>					
0.04 % accuracy for applicable ranges			(Notes 17, 21)	D2	
<b>Drain/vent valve material (wetted parts)</b>					
AISI 316 L ss	(Notes 2, 10, 16)	NACE		VA	
Hastelloy® C-276	(Notes 2, 11, 16)	NACE		VB	
Monel 400®	(Notes 2, 12, 16)	NACE		VC	
<b>Hazardous area certifications</b>					
ATEX Intrinsic Safety Ex ia			(Notes 8, 9)		E1
ATEX Explosion Proof Ex d			(Notes 8, 9, 13, 21)		E2
ATEX Intrinsic Safety Ex ic			(Notes 8, 9, 21)		E3
Combined ATEX - Intrinsic Safety Ex ia, Explosion Proof and Intrinsic Safety Ex ic			(Notes 8, 9, 13, 21)		EW
Combined ATEX - Intrinsic Safety Ex ia and Explosion Proof			(Notes 8, 9, 13, 21)		E7
Combined ATEX, IECEx, FM Approvals (USA) and FM Approvals (Canada)			(Notes 8, 9, 13, 21)		EN
FM Approvals (Canada) approval			(Notes 8, 9, 13, 21)		E4
FM Approvals (USA) approval			(Notes 8, 9, 13, 21)		E6
FM Approvals (USA and Canada) Intrinsic Safety			(Notes 8, 9)		EA
FM Approvals (USA and Canada) Explosion Proof			(Notes 8, 9, 13, 21)		EB
FM Approvals (USA and Canada) Nonincendive			(Notes 8, 9, 21)		EC
IECEx Intrinsic Safety Ex ia			(Notes 8, 9)		E8
IECEx Explosion Proof Ex d			(Notes 8, 9, 13, 21)		E9
IECEx Intrinsic Safety Ex ic			(Notes 8, 9, 21)		ER
Combined IECEx - Intrinsic Safety Ex ia, Explosion Proof and Intrinsic Safety Ex ic			(Notes 8, 9, 13, 21)		EI
Combined IECEx - Intrinsic Safety Ex ia and Explosion Proof			(Notes 8, 9, 13, 21)		EH
NEPSI Intrinsic Safety Ex ia			(Notes 2, 8, 9, 21)		EY
NEPSI Explosion Proof Ex d			(Notes 2, 8, 9, 13, 21)		EZ
NEPSI Type „N“			(Notes 2, 8, 9, 21)		ES
Combined NEPSI - Intrinsic Safety Ex ia, Explosion Proof and Type „N“			(Notes 2, 8, 9, 13, 21)		EQ
Combined NEPSI - Intrinsic Safety Ex ia and Explosion Proof			(Notes 2, 8, 9, 13, 21)		EP
Combined Intrinsic Safety - ATEX, IECEx and FM Approvals (USA and Canada)			(Notes 2, 22)		EF



ADDITIONAL ORDERING INFORMATION for model 266HSH						XX	XX	XX	XX	XX	XX
<b>Other hazardous area certifications (ONLY AS ALTERNATIVE TO BASIC CERTIFICATION CODE Ex)</b>											
Technical Regulations Customs Union (EAC) Intrinsic Safety Ex ia for Russia	(Notes 8, 9, 21)	W1									
Technical Regulations Customs Union (EAC) Explosion Proof Ex d for Russia	(Notes 8, 9, 13, 21)	W2									
Technical Regulations Customs Union (EAC) combined Ex ia and Ex d for Russia	(Notes 8, 9, 13, 21)	WC									
Technical Regulations Customs Union (EAC) Intrinsic Safety Ex ia for Kazakhstan	(Notes 8, 9, 21)	W3									
Technical Regulations Customs Union (EAC) Explosion Proof Ex d for Kazakhstan	(Notes 8, 9, 13, 21)	W4									
Technical Regulations Customs Union (EAC) combined Ex ia and Ex d for Kazakhstan	(Notes 8, 9, 13, 21)	WD									
Inmetro (Brazil) Ex ia	(Notes 2, 8, 9, 21)	W5									
Inmetro (Brazil) Ex d	(Notes 2, 8, 9, 13, 21)	W6									
Inmetro (Brazil) Ex nL	(Notes 2, 8, 9, 21)	W7									
Combined Inmetro (Brazil) - Intrinsic Safety, Explosion Proof and Type „N“	(Notes 2, 8, 9, 13, 21)	W8									
Technical Regulations Customs Union (EAC) Intrinsic Safety Ex ia for Belarus	(Notes 8, 9, 16, 21)	WF									
Technical Regulations Customs Union (EAC) Explosion Proof Ex d for Belarus	(Notes 8, 9, 13, 21)	WG									
Technical Regulations Customs Union (EAC) combined Ex ia and Ex d for Belarus	(Notes 8, 9, 13, 21)	WH									
Kosha (Korea) Intrinsic Safety Ex ia IIC T6, IP67	(Notes 2, 8, 9, 18, 21)	WM									
Kosha (Korea) Explosion Proof Ex d IIC T6, IP67	(Notes 2, 8, 9, 13, 18, 21)	WN									
Combined Kosha (Korea) - Intrinsic Safety and Explosion Proof	(Notes 2, 8, 9, 13, 18, 21)	WP									
<b>Integral LCD</b>											
Digital LCD integral display with integrated keypad	(Note 18)	L1									
Digital LCD integral display with TTG (Through-The-Glass) activated keypad	(Note 18)	L5									
Integrated digital LCD display (ONLY SELECTABLE WITH OUTPUT CODE 7)	(Note 24)	LS									
<b>External non intrusive Z, S and WP pushbuttons</b>											
Transmitters with external pushbutton (ONLY SELECTABLE WITH OUTPUT CODE 7)								R1			
<b>Mounting bracket (shape and material)</b>											
For pipe/wall mounting - Carbon steel	(Not suitable for AISI housing)								B6		
For pipe/wall mounting - AISI 316 L ss									B7		
<b>Surge</b>											
Surge/Transient Protector	(Note 21)									S2	
<b>Operating manual (multiple selection allowed)</b>											
German (FOR HART, WirelessHART and PROFIBUS VERSIONS)										M1	
Italian (ONLY FOR HART VERSIONS)										M2	
Spanish (FOR HART, WirelessHART and FOUNDATION Fieldbus VERSIONS)										M3	
French (ONLY FOR HART VERSIONS)										M4	
English										M5	
Chinese (ONLY FOR HART VERSIONS)										M6	
Swedish (ONLY FOR HART VERSIONS)										M7	
Polish (ONLY FOR HART VERSIONS)										M9	
Portuguese (ONLY FOR HART VERSIONS)										MA	
Russian (ONLY FOR HART VERSIONS)										MB	
Dutch (ONLY FOR HART VERSIONS)										MD	
Danish (ONLY FOR HART VERSIONS)										MF	
Japanese (ONLY FOR HART VERSIONS)										MJ	
Romenian (ONLY FOR HART VERSIONS)										MR	
Turkish (ONLY FOR HART VERSIONS)										MT	

# Model 266HSH Gauge

# Model 266NSH Absolute

ADDITIONAL ORDERING INFORMATION for model 266HSH					XX	XX	XX	XX	XX
<b>Plates language</b>									
German					T1				
Italian					T2				
Spanish					T3				
French					T4				
<b>Additional tag plate</b>									
Supplemental wired-on stainless steel plate					I1				
Tag and certification stainless steel plates and laser printing of tag					I2				
Tag, certification and supplemental wired-on stainless steel plates and laser printing of tag					I3				
<b>Configuration</b>									
Standard – Pressure = inH2O/ psi at 68 °F; Temperature = deg. F								N2	
Standard – Pressure = inH2O/ psi at 39.2 °F; Temperature = deg. F								N3	
Standard – Pressure = inH2O/ psi at 20 °C; Temperature = deg. C								N4	
Standard – Pressure = inH2O/ psi at 4 °C; Temperature = deg. C								N5	
Custom								N6	
<b>Preparation procedure</b>									
Oxygen service cleaning (only available with inert fill)							(Notes 2, 16, 19)		P1
Pmax =10 MPa for Galden, 9 MPa for Halocarbon for sensors E to S; Tmax=60 °C/140 °F									
<b>Certificates (multiple selection allowed)</b>									
Inspection certificate EN 10204–3.1 of calibration (9-point)									C1
Inspection certificate EN 10204–3.1 of the cleanliness stage									C3
Inspection certificate EN 10204–3.1 of helium leakage test of the sensor module									C4
Inspection certificate EN 10204–3.1 of the pressure test									C5
Certificate of compliance with the order EN 10204–2.1 of instrument design									C6
Printed record of configured data of transmitter									CG
PMI test of wetted parts (FOR SENSOR Z, APPLIES ONLY TO THE PROCESS CONNECTION)									CT

ADDITIONAL ORDERING INFORMATION FOR MODEL 266HSH		XX	XX	XX	XX	XX
<b>Approvals</b>						
GOST (Russia) Metrologic Pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y1				
GOST (Kazakhstan) Metrologic Pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y2				
GOST (Belarus) Metrologic Pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y4				
Chinese pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y5				
DNV approval	(Notes 2, 16, 18, 21)	YA				
Approval for Custody transfer (PENDING)		YC				
Conformity to NAMUR NE 021 (2004)	(NOT APPLICABLE WITH SURGE PROTECTOR CODE "S2") (Notes 18, 21, 23, 25)	YE				
<b>Material traceability</b>						
Certificate of compliance with the order EN 10204–2.1 of process wetted parts						H1
Inspection certificate EN 10204–3.1 of process wetted parts						H3
Test report EN 10204–2.2 of pressure bearing and process wetted parts						H4
<b>Connector</b>						
Fieldbus 7/8 in. (Recommended for FOUNDATION Fieldbus) - (supplied loose without mating female plug)	(Notes 9, 14, 21)					U1
Fieldbus M12x1 (Recommended for PROFIBUS PA) - (supplied loose without mating female plug)	(Notes 9, 14, 21)					U2
Harting Han 8D – straight entry - (supplied loose)	(Notes 8, 14, 21)					U3
Harting Han 8D – angle entry - (supplied loose)	(Notes 8, 14, 21)					U4
<b>Accessory</b>						
Manifold mounting and pressure test (NOT AVAILABLE WITH OXYGEN SERVICE CLEANING - PREPARATION PROCEDURE CODE P1)						A1

Note 1: Suitable for oxygen service

Note 2: Not available with Sensor code W

Note 3: Not available with sensor code E to S

Note 4: Not available with diaphragm code M, T, C, D, 4, 5

Note 5: Not available with diaphragm code S, A, L, M, C, 4, 8, 9, I

Note 6: Not available with diaphragm code S, K, T, A, F, D, L, P, 5, E, G, 8, 9, I

Note 7: Select type in additional ordering code

Note 8: Not available with Housing code G, Z, W, F

Note 9: Not available with Housing code E, K

Note 10: Not available with Process connection code E, K, D, F, C, 1, 2, 3

Note 11: Not available with Process connection code B, T, A, P, N, 1, 2, 3

Note 12: Not available with Process connection code E, K, D, F, C, B, T, A, P, N

Note 13: Not available with Housing code J, K, W

Note 14: Not available with Housing code A, B, S, T, J

Note 15: Not available with Sensor code E

Note 16: Not available with Sensor code Z

Note 17: Not available with Sensor code E, S, W, Z

Note 18: Not available with Output code 7

Note 19: Not available with Process connection code P, A, N, D, F, C, 3

Note 20: Not available with Housing code A, E, G, S, Z, C, F, J, K, W

Note 21: Not available with Output code 9, W

Note 22: Not available with Output code 1, 2, 3, 7, 8

Note 23: Not available with Output code 2, 3

Note 24: Not available with Hazardous area certification code EY, EZ, ES, EQ, EP, W1, W2, WC, W3, W4, WD, W5, W6, W7, W8, WF, WG, WH, WM, WN, WP

Note 25: Not available with Hazardous area certification code EW, EN, E4, E6, EA, EB, EC, EY, EZ, ES, EQ, EP, W1, W2, WC, W3, W4, WD, W5, W6, W7, W8, WF, WG, WH, WM, WN, WP

### Standard delivery items (can be differently specified by additional ordering code)

- No drain/vent valves
- General purpose (no electrical certification)
- No display, no mounting bracket, no surge protection
- Multilanguage short-form operating instruction manual and labels in english (metal nameplate; self-adhesive certification and tag)
- Configuration with kPa and deg. C units
- No test, inspection or material traceability certificates

# Model 266HSH Gauge

## Model 266NSH Absolute

### BASIC ORDERING INFORMATION model 266NSH Absolute Pressure Transmitter

Select one character or set of characters from each category and specify complete catalog number.

Refer to additional ordering information and specify one or more codes for each transmitter if additional options are required.

BASE MODEL - 1 <sup>st</sup> to 6 <sup>th</sup> characters			2	6	N	S	H	X	X	X	X	X
Absolute Pressure Transmitter – BASE ACCURACY 0.075 %												
SENSOR - Span limits - 7 <sup>th</sup> character												
0.67 and 40 kPa	6.7 and 400 mbar	5 and 300 mmHg						F				
2.67 and 160 kPa	26.7 and 1600 mbar	20 and 1200 mmHg						H				
10 and 600 kPa	0.1 and 6 bar	1.45 and 87 psi						M				
40 and 2400 kPa	0.4 and 24 bar	5.8 and 348 psi						P				
134 and 8000 kPa	1.34 and 80 bar	19.4 and 1160 psi						Q				
267 and 16000 kPa	2.67 and 160 bar	38.7 and 2320 psi						S				
Diaphragm material / Fill fluid (wetted parts) - 8 <sup>th</sup> character												
AISI 316 L ss	Silicone oil							NACE	S			
Hastelloy® C-276	Silicone oil							NACE	K			
AISI 316 L ss	Inert fluid - Galden	(Note 1)						NACE	A			
Hastelloy® C-276	Inert fluid - Galden	(Note 1)						NACE	F			
AISI 316 L ss	Inert fluid - Halocarbon	(Note 1)						NACE	L			
Hastelloy® C-276	Inert fluid - Halocarbon	(Note 1)						NACE	P			

continued  
see next page

BASIC ORDERING INFORMATION model 266NSH Absolute Pressure Transmitter				2	6	N	S	H	X	X	X
<b>Process connection (wetted parts) - 9<sup>th</sup> character</b>											
AISI 316 L ss	1/2 in. – 14 NPT female		NACE	B							
AISI 316 L ss	1/2 in. – 14 NPT male		NACE	T							
AISI 316 L ss	DIN EN837-1 G 1/2 B		NACE	P							
AISI 316 L ss	Adapter straight (180°) entry (not available with bracket)		NACE	A							
AISI 316 L ss	Adapter angle (90°) entry		NACE	N							
Hastelloy® C-276	1/2 in. – 14 NPT female	(Note 3)	NACE	E							
Hastelloy® C-276	1/2 in. – 14 NPT male	(Note 3)	NACE	K							
Hastelloy® C-276	DIN EN837-1 G 1/2 B	(Note 3)	NACE	D							
Hastelloy® C-276	Adapter straight (180°) entry (not available with bracket)	(Note 3)	NACE	F							
Hastelloy® C-276	Adapter angle (90°) entry	(Note 3)	NACE	C							
<b>Housing material and electrical connection - 10<sup>th</sup> character</b>											
Aluminium alloy (barrel version)	1/2 in. – 14 NPT		(Note 14)	A							
Aluminium alloy (barrel version)	M20 x 1.5 (CM 20)	(TO BE USED for WirelessHART)		B							
Aluminium alloy (barrel version)	Harting Han 8D connector	(general purpose only)	(Notes 4, 14)	E							
Aluminium alloy (barrel version)	Fieldbus connector	(general purpose only)	(Notes 4, 14)	G							
AISI 316 L ss (barrel version) (I2 or I3 required)	1/2 in. – 14 NPT		(Note 14)	S							
AISI 316 L ss (barrel version) (I2 or I3 required)	M20 x 1.5 (CM20)	(TO BE USED for WirelessHART)		T							
AISI 316 L ss (barrel version) (I2 or I3 required)	Fieldbus connector	(general purpose only)	(Notes 4, 14)	Z							
AISI 316 L ss painted (barrel version) (I2 or I3 required)	1/2 in. – 14 NPT		(Note 14)	C							
AISI 316 L ss painted (barrel version) (I2 or I3 required)	M20 x 1.5 (CM20)	(TO BE USED for WirelessHART)		D							
AISI 316 L ss painted (barrel version) (I2 or I3 required)	Fieldbus connector	(general purpose only)	(Notes 4, 14)	F							
Aluminium alloy (DIN version)	M20 x 1.5 (CM20)	(not Ex d or XP)	(Note 14)	J							
Aluminium alloy (DIN version)	Harting Han 8D connector	(general purpose only)	(Notes 4, 14)	K							
Aluminium alloy (DIN version)	Fieldbus connector	(general purpose only)	(Notes 4, 14)	W							
<b>Output/Additional options - 11<sup>th</sup> character</b>											
HART and 4 to 20 mA - Standard functionality	No additional options		(Notes 5, 6)	L							
HART and 4 to 20 mA - Standard functionality	Options requested by "Additional ordering code"	(Note 5)		7							
HART and 4 to 20 mA - Advanced functionality (includes option R1)	No additional options		(Notes 5, 6)	H							
HART and 4 to 20 mA - Advanced functionality (includes option R1)	Options requested by "Additional ordering code"	(Note 5)		1							
PROFIBUS PA (includes option R1)	No additional options		(Notes 5, 6)	P							
PROFIBUS PA (includes option R1)	Options requested by "Additional ordering code"	(Note 6)		2							
FOUNDATION Fieldbus (includes option R1)	No additional options		(Notes 5, 6)	F							
FOUNDATION Fieldbus (includes option R1)	Options requested by "Additional ordering code"	(Note 6)		3							
HART and 4 to 20 mA Safety, certified to IEC 61508 (includes option R1)	No additional options		(Notes 5, 6)	T							
HART and 4 to 20 mA Safety, certified to IEC 61508 (includes option R1)	Options requested by "Additional ordering code"	(Note 5)		8							
WirelessHART (includes option R1)	No additional options		(Note 13)	W							
WirelessHART (includes option R1)	Options requested by "Additional ordering code"	(Note 13)		9							

NOTE - Option R1 represents the external pushbuttons

# Model 266HSH Gauge

# Model 266NSH Absolute

## ADDITIONAL ORDERING INFORMATION for model 266NSH

Add one or more 2-digit code(s) after the basic ordering information to select all required options

			XX	XX
<b>Drain/vent valve material (wetted parts)</b>				
AISI 316 L ss	(Note 7)	NACE	VA	
Hastelloy® C-276	(Note 8)	NACE	VB	
<b>Hazardous area certifications</b>				
ATEX Intrinsic Safety Ex ia			(Notes 5, 6)	E1
ATEX Explosion Proof Ex d			(Notes 5, 6, 9, 14)	E2
ATEX Intrinsic Safety Ex ic			(Notes 5, 6, 14)	E3
Combined ATEX - Intrinsic Safety Ex ia, Explosion Proof and Intrinsic Safety Ex ic			(Notes 5, 6, 9, 14)	EW
Combined ATEX - Intrinsic Safety Ex ia and Explosion Proof			(Notes 5, 6, 9, 14)	E7
Combined ATEX, IECEx, FM Approvals (USA) and FM Approvals (Canada)			(Notes 5, 6, 9, 14)	EN
FM Approvals (Canada) approval			(Notes 5, 6, 9, 14)	E4
FM Approvals (USA) approval			(Notes 5, 6, 9, 14)	E6
FM Approvals (USA and Canada) Intrinsic Safety			(Notes 5, 6)	EA
FM Approvals (USA and Canada) Explosion Proof			(Notes 5, 6, 9, 14)	EB
FM Approvals (USA and Canada) Nonincendive			(Notes 5, 6, 14)	EC
IECEx Intrinsic Safety Ex ia			(Notes 5, 6)	E8
IECEx Explosion Proof Ex d			(Notes 5, 6, 9, 14)	E9
IECEx Intrinsic Safety Ex ic			(Notes 5, 6, 14)	ER
Combined IECEx - Intrinsic Safety Ex ia, Explosion Proof and Intrinsic Safety Ex ic			(Notes 5, 6, 9, 14)	EI
Combined IECEx - Intrinsic Safety Ex ia and Explosion Proof			(Notes 5, 6, 9, 14)	EH
NEPSI Intrinsic Safety Ex ia			(Notes 5, 6, 14)	EY
NEPSI Explosion Proof Ex d			(Notes 5, 6, 9, 14)	EZ
NEPSI Type „N“			(Notes 5, 6, 14)	ES
Combined NEPSI - Intrinsic Safety Ex ia, Explosion Proof and Type „N“			(Notes 5, 6, 9, 14)	EQ
Combined NEPSI - Intrinsic Safety Ex ia and Explosion Proof			(Notes 5, 6, 9, 14)	EP
Combined Intrinsic Safety - ATEX, IECEx and FM Approvals (USA and Canada)			(Note 15)	EF

ADDITIONAL ORDERING INFORMATION for model 266NSH						XX	XX	XX	XX	XX	XX
<b>Other hazardous area certifications (ONLY AS ALTERNATIVE TO BASIC CERTIFICATION CODE Ex)</b>											
Technical Regulations Customs Union (EAC) Intrinsic Safety Ex ia for Russia	(Notes 5, 6, 14)	W1									
Technical Regulations Customs Union (EAC) Explosion Proof Ex d for Russia	(Notes 5, 6, 9, 14)	W2									
Technical Regulations Customs Union (EAC) combined Ex ia and Ex d for Russia	(Notes 5, 6, 9, 14)	WC									
Technical Regulations Customs Union (EAC) Intrinsic Safety Ex ia for Kazakhstan	(Notes 5, 6, 14)	W3									
Technical Regulations Customs Union (EAC) Explosion Proof Ex d for Kazakhstan	(Notes 5, 6, 9, 14)	W4									
Technical Regulations Customs Union (EAC) combined Ex ia and Ex d for Kazakhstan	(Notes 5, 6, 9, 14)	WD									
Inmetro (Brazil) Ex ia	(Notes 5, 6, 14)	W5									
Inmetro (Brazil) Ex d	(Notes 5, 6, 9, 14)	W6									
Inmetro (Brazil) Ex nL	(Notes 5, 6, 14)	W7									
Combined Inmetro (Brazil) - Intrinsic Safety, Explosion Proof and Type „N“	(Notes 5, 6, 9, 14)	W8									
Technical Regulations Customs Union (EAC) Intrinsic Safety Ex ia for Belarus	(Notes 5, 6, 14)	WF									
Technical Regulations Customs Union (EAC) Explosion Proof Ex d for Belarus	(Notes 5, 6, 9, 14)	WG									
Technical Regulations Customs Union (EAC) combined Ex ia and Ex d for Belarus	(Notes 5, 6, 9, 14)	WH									
Kosha (Korea) Intrinsic Safety Ex ia IIC T6, IP67	(Notes 5, 6, 11, 14)	WM									
Kosha (Korea) Explosion Proof Ex d IIC T6, IP67	(Notes 5, 6, 9, 11, 14)	WN									
Combined Kosha (Korea) - Intrinsic Safety and Explosion Proof	(Notes 5, 6, 9, 11, 14)	WP									
<b>Integral LCD</b>											
Digital LCD integral display with integrated keypad	(Note 11)	L1									
Digital LCD integral display with TTG (Through-The-Glass) activated keypad	(Note 11)	L5									
Integrated digital LCD display (ONLY SELECTABLE WITH OUTPUT CODE 7)	(Note 17)	LS									
<b>External non intrusive Z, S and WP pushbuttons</b>											
Transmitters with external pushbutton (ONLY SELECTABLE WITH OUTPUT CODE 7)									R1		
<b>Mounting bracket (shape and material)</b>											
For pipe/wall mounting - Carbon steel	(Not suitable for AISI housing)								B6		
For pipe/wall mounting - AISI 316 L ss									B7		
<b>Surge</b>											
Surge/Transient Protector	(Note 14)									S2	
<b>Operating manual (multiple selection allowed)</b>											
German (FOR HART, WirelessHART and PROFIBUS VERSIONS)										M1	
Italian (ONLY FOR HART VERSIONS)										M2	
Spanish (FOR HART, WirelessHART and FOUNDATION Fieldbus VERSIONS)										M3	
French (ONLY FOR HART VERSIONS)										M4	
English										M5	
Chinese (ONLY FOR HART VERSIONS)										M6	
Swedish (ONLY FOR HART VERSIONS)										M7	
Polish (ONLY FOR HART VERSIONS)										M9	
Portuguese (ONLY FOR HART VERSIONS)										MA	
Russian (ONLY FOR HART VERSIONS)										MB	
Dutch (ONLY FOR HART VERSIONS)										MD	
Danish (ONLY FOR HART VERSIONS)										MF	
Japanese (ONLY FOR HART VERSIONS)										MJ	
Romenian (ONLY FOR HART VERSIONS)										MR	
Turkish (ONLY FOR HART VERSIONS)										MT	

# Model 266HSH Gauge

## Model 266NSH Absolute

ADDITIONAL ORDERING INFORMATION for model 266NSH					XX	XX	XX	XX	XX
<b>Plates language</b>									
German					T1				
Italian					T2				
Spanish					T3				
French					T4				
<b>Additional tag plate</b>									
Supplemental wired-on stainless steel plate					I1				
Tag and certification stainless steel plates and laser printing of tag					I2				
Tag, certification and supplemental wired-on stainless steel plates and laser printing of tag					I3				
<b>Configuration</b>									
Standard – Pressure = inH2O/ psi at 68 °F; Temperature = deg. F							N2		
Standard – Pressure = inH2O/ psi at 39.2 °F; Temperature = deg. F							N3		
Standard – Pressure = inH2O/ psi at 20 °C; Temperature = deg. C							N4		
Standard – Pressure = inH2O/ psi at 4 °C; Temperature = deg. C							N5		
Custom							N6		
<b>Preparation procedure</b>									
Oxygen service cleaning (only available with inert fill)						(Note 12)		P1	
Pmax =12 MPa for Galden, 9 MPa for Halocarbon; Tmax=60 °C/140 °F									
<b>Certificates (multiple selection allowed)</b>									
Inspection certificate EN 10204–3.1 of calibration (9-point)									C1
Inspection certificate EN 10204–3.1 of the cleanliness stage									C3
Inspection certificate EN 10204–3.1 of helium leakage test of the sensor module									C4
Inspection certificate EN 10204–3.1 of the pressure test									C5
Certificate of compliance with the order EN 10204–2.1 of instrument design									C6
Printed record of configured data of transmitter									CG
PMI test of wetted parts									CT



ADDITIONAL ORDERING INFORMATION FOR MODEL 266NSH			XX	XX	XX	XX	XX
<b>Approvals</b>							
GOST (Russia) Metrologic Pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y1					
GOST (Kazakhstan) Metrologic Pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y2					
GOST (Belarus) Metrologic Pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y4					
Chinese pattern	(NOT APPLICABLE WITH ANY HAZARDOUS AREA CERTIFICATION)	Y5					
DNV approval	(Notes 11, 14)	YA					
Approval for Custody transfer (PENDING)		YC					
Conformity to NAMUR NE 021 (2004)	(NOT APPLICABLE WITH SURGE PROTECTOR CODE "S2") (Notes 11, 14, 16, 18)	YE					
<b>Material traceability</b>							
Certificate of compliance with the order EN 10204–2.1 of process wetted parts						H1	
Inspection certificate EN 10204–3.1 of process wetted parts						H3	
Test report EN 10204–2.2 of pressure bearing and process wetted parts						H4	
<b>Connector</b>							
Fieldbus 7/8 in. (Recommended for FOUNDATION Fieldbus) - (supplied loose without mating female plug)	(Notes 6, 10, 14)	U1					
Fieldbus M12x1 (Recommended for PROFIBUS PA) - (supplied loose without mating female plug)	(Notes 6, 10, 14)	U2					
Harting Han 8D – straight entry - (supplied loose)	(Notes 5, 10, 14)	U3					
Harting Han 8D – angle entry - (supplied loose)	(Notes 5, 10, 14)	U4					
<b>Accessory</b>							
Manifold mounting and pressure test (NOT AVAILABLE WITH OXYGEN SERVICE CLEANING - PREPARATION PROCEDURE CODE P1)							A1

Note 1: Suitable for oxygen service

Note 2: NOT USED

Note 3: Not available with AISI 316 L ss diaphragm code S, A, L

Note 4: Select type in additional ordering code

Note 5: Not available with Housing code G, Z, W, F

Note 6: Not available with Housing code E, K

Note 7: Not available with Process connection code E, K, D, F, C

Note 8: Not available with Process connection code B, T, A, P, N

Note 9: Not available with Housing code J, K, W

Note 10: Not available with Housing code A, B, S, T, J

Note 11: Not available with Output code 7

Note 12: Not available with Process connection code P, A, N, D, F, C

Note 13: Not available with Housing code A, E, G, S, Z, C, F, J, K, W

Note 14: Not available with Output code 9, W

Note 15: Not available with Output code 1, 2, 3, 7, 8

Note 16: Not available with Output code 2, 3

Note 17: Not available with Hazardous area certification code EY, EZ, ES, EQ, EP, W1, W2, WC, W3, W4, WD, W5, W6, W7, W8, WF, WG, WH, WM, WN, WP

Note 18: Not available with Hazardous area certification code EW, EN, E4, E6, EA, EB, EC, EY, EZ, ES, EQ, EP, W1, W2, WC, W3, W4, WD, W5, W6, W7, W8, WF, WG, WH, WM, WN, WP

### Standard delivery items (can be differently specified by additional ordering code)

- No drain/vent valves
- General purpose (no electrical certification)
- No display, no mounting bracket, no surge protection
- Multilanguage short-form operating instruction manual and labels in english (metal nameplate; self-adhesive certification and tag)
- Configuration with kPa and deg. C units
- No test, inspection or material traceability certificates

# Model 266HSH Gauge

## Model 266NSH Absolute

### **IMPORTANT REMARK FOR ALL MODELS**

THE SELECTION OF SUITABLE WETTED PARTS AND FILLING FLUID FOR COMPATIBILITY WITH THE PROCESS MEDIA IS A CUSTOMER'S RESPONSIBILITY, IF NOT OTHERWISE NOTIFIED BEFORE MANUFACTURING.

### **NACE COMPLIANCE INFORMATION**

- (1) The materials of constructions comply with metallurgical recommendations of NACE MR0175/ISO 15156 for sour oil field production environments. As specific environmental limits may apply to certain materials, please consult latest standard for further details. AISI 316/316 L, Hastelloy C-276, Monel 400 also conform to NACE MR0103 for sour refining environments.
- (2) NACE MR-01-75 addresses bolting requirements in two classes:
  - Exposed bolts: bolts directly exposed to the sour environment or buried, encapsulated or anyway not exposed to atmosphere
  - Non exposed bolts: the bolting must not be directly exposed to sour environments and must be directly exposed to the atmosphere at all times.

® Hastelloy is a registered trademark of Haynes International  
® Monel and Inconel are registered trademarks of Special Metals Corporation  
® Galden is a registered trademark of Solvay Group  
® Halocarbon is a registered trademark of Halocarbon Products Co.  
® HART and WirelessHART are registered trademarks of HART Communication Foundation  
® PROFIBUS is a registered trademark of Profibus International  
™ FOUNDATION Fieldbus is a trademark of Fieldbus Foundation



# Contact us

## **ABB Ltd.**

### **Process Automation**

Howard Road  
St. Neots  
Cambridgeshire PE19 8EU  
UK  
Tel: +44 (0)1480 475321  
Fax: +44 (0)1480 217948

## **ABB Inc.**

### **Process Automation**

125 E. County Line Road  
Warminster  
PA 18974  
USA  
Tel: +1 215 674 6000  
Fax: +1 215 674 7183

## **ABB Automation Products GmbH**

### **Process Automation**

Schillerstr. 72  
32425 Minden  
Germany  
Tel: +49 551 905 534  
Fax: +49 551 905 555

## **ABB S.p.A.**

### **Process Automation**

Via Luigi Vaccani 4  
22016 Tremezzina (CO)  
Italy  
Tel: +39 0344 58111

**[www.abb.com](http://www.abb.com)**

## **Note**

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents - in whole or in parts - is forbidden without prior written consent of ABB.

Copyright© 2016 ABB  
All rights reserved

3KXP200015R1001



Sales



Service



Software